


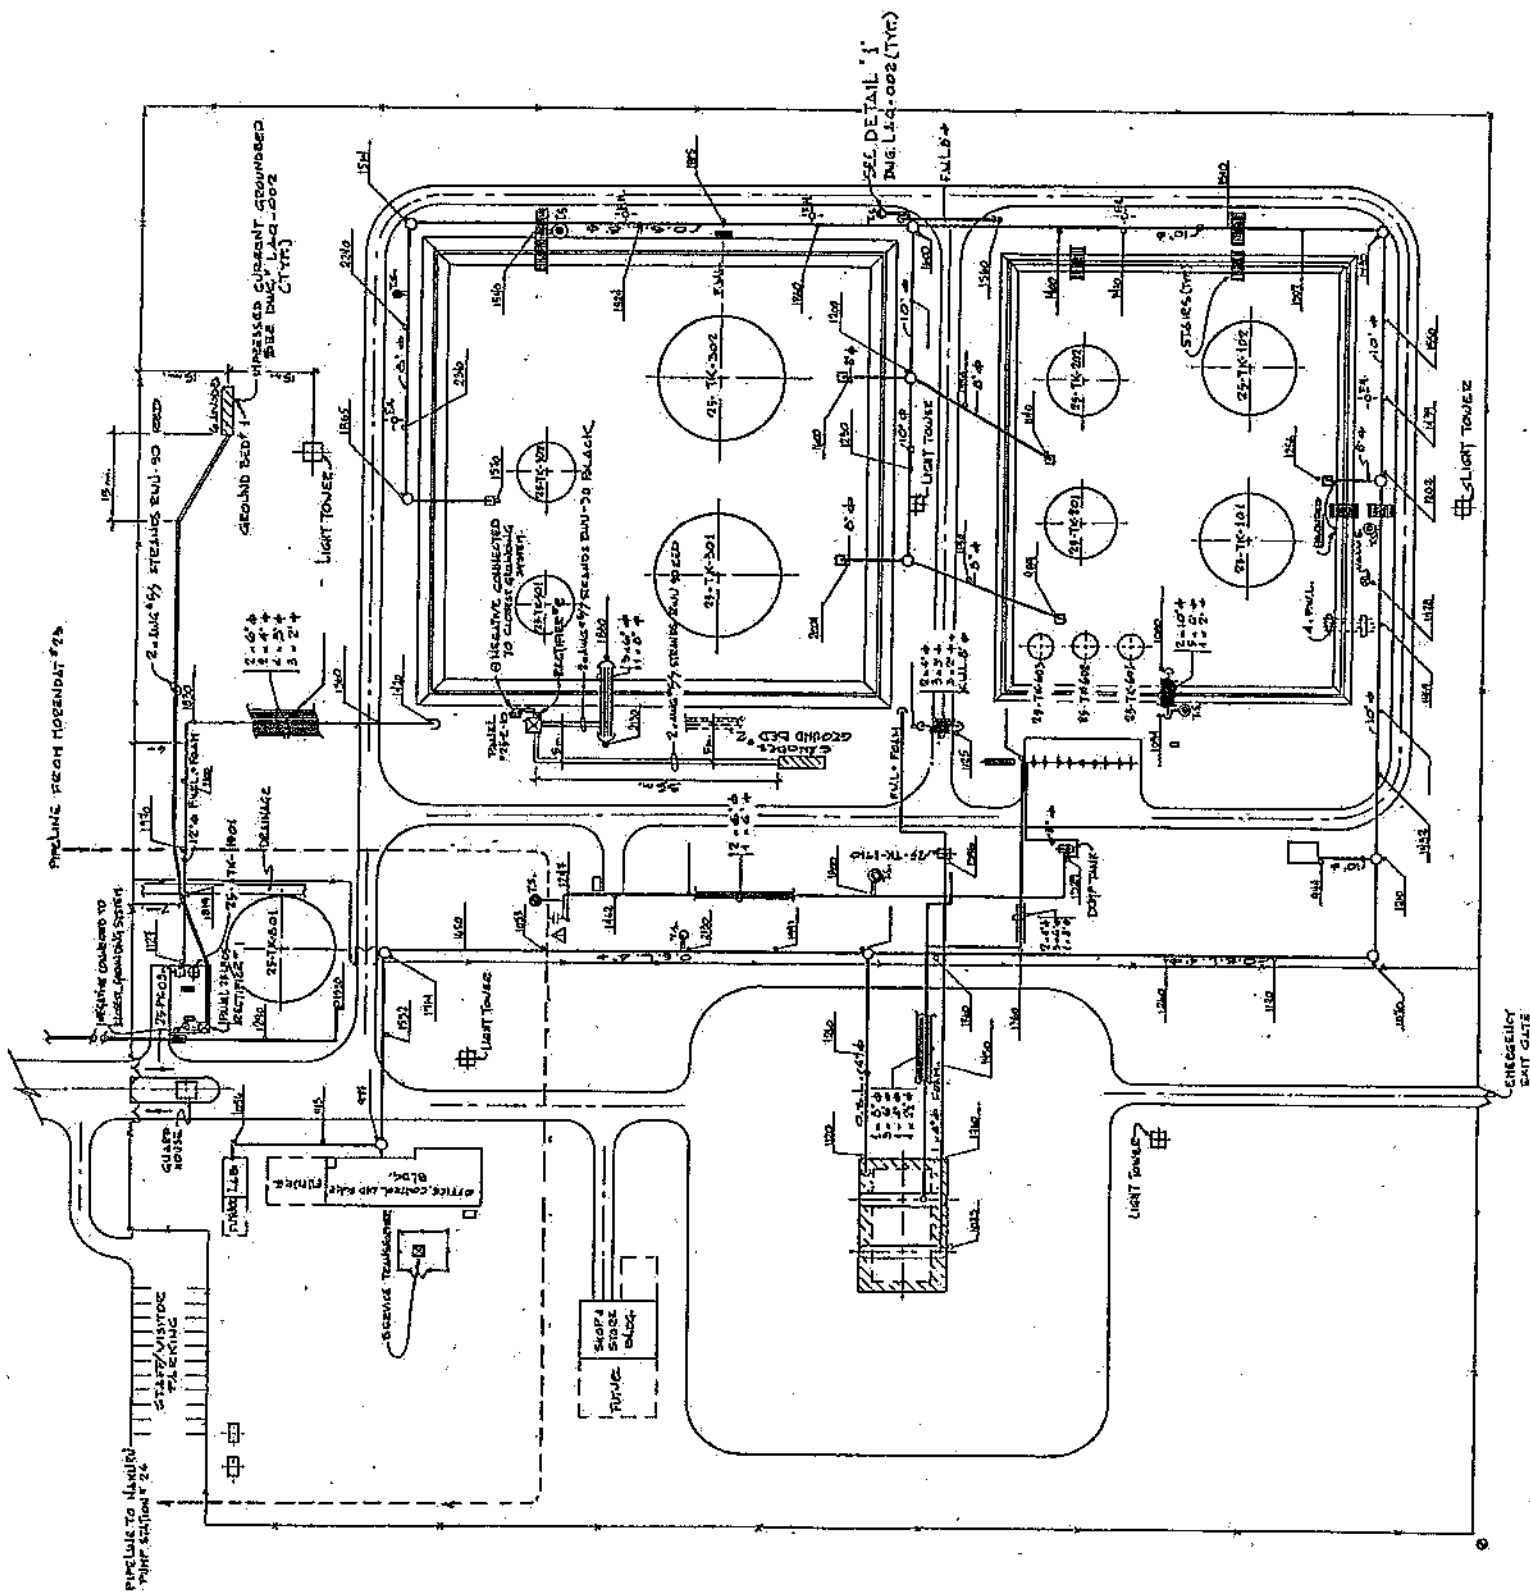

LEGEND:

- CATHODIC PROTECTION
ANODES SHALL BE 500 MM²
SILICON CARBIDE ANODES
WITH SILICON CARBIDE ANODE
ANODES GROUND BED
- ⌊ HEATING CONNECTION
(THERMIT WELD) TO
UNDERGROUND LINE
- ⊠ ELECTRICAL PANEL CONTAINING
ELECTRICAL

NOTE:

SUBCONTRACTOR SHALL CHECK AND VERIFY
THE LOCATIONS OF ALL UNDERGROUND PIPES
(STEEL, PVC, OTHER) AND CLOSING BEFORE ANY
DIGGING EXCAVATING

AS BUILT

Sheet No.	Rev.	Rev. Description	Rev. Date
01-01	01	Initial Issue	11/11/2011
01-02	02	As Built	11/11/2011
01-03	03	Final	11/11/2011

COREXCO INC.	
CORPORATION INTERESTS IN CONNECTION	
Project No.	11-001
Project Name	LAVALIN INTERVENTIONAL INC.
Project Location	WEST KENIA PIPELINE EXTENSION PROJECT
Project Type	CATHODIC PROTECTION
Project Size	1.5 KM
Project Status	LAUNCH SURVEY
Project Date	11/11/2011
Project Drawn	11/11/2011
Project Checked	11/11/2011
Project Approved	11/11/2011

A1-25-EE-001 REV.1

DRAWING INDEX

1	2	3	4	5	6
LOAD PUMP - MSP 25-P-02A/02B MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7503	PLANT LIGHTING PANEL SCHEDULES	A1-25-EE-4301	DRAWING INDEX	A1-25-EE-2100
LOAD PUMP - AGO 25-P-03A MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7504	OFFICE, CONTROL AND SWGR. BLDG. AREA POWER AND CONTROL LAYOUT	A1-25-EE-6101	ELECTRICAL PLAN SYMBOLS	A1-01-EE-2101
LOAD PUMP - AGO 25-P-03B MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7505	EAST TANK FARM - SHT. 1 POWER AND CONTROL LAYOUT	A1-25-EE-6102	SINGLE LINE AND SCHEMATIC SYMBOLS	A1-01-EE-2102
LOAD PUMP - IK 25-P-04A/04B MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7506	EAST TANK FARM - SHT. 2 POWER AND CONTROL LAYOUT	A1-25-EE-6103	KEY PLAN NORTH	A1-25-EE-2103
OWS OIL/WATER 25-P-07A/07B MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7507	WEST TANK FARM - SHT. 1 POWER AND CONTROL LAYOUT	A1-25-EE-6104	KEY PLAN SOUTH	A1-25-EE-2104
INTERFACE LOAD PUMP 25-P-05 MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7508	PROVER AND METERING AREA POWER AND CONTROL LAYOUT	A1-25-EE-6105	ELECTRICAL MATERIAL LIST	A1-01-EE-2105
BLENDING PUMP A/B 25-P-11A/11B MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7509	LOADING PUMP AND MANIFOLD POWER AND CONTROL LAYOUT	A1-25-EE-6106	ELECTRICAL MATERIAL LIST	A1-01-EE-2106
DUMP PUMP 25-P-06 MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7510	SEPARATOR AREA POWER AND CONTROL LAYOUT	A1-25-EE-6107	FENCE EARTHING AND AREA TRENCHING PLAN - NORTH	A1-25-EE-2107
EXHAUST FAN 25-K-01/YARD LTG. 25-LF-01 SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7511	TRUCK LOADING SHELTER AREA POWER AND CONTROL LAYOUT	A1-25-EE-6108	FENCE EARTHING AND AREA TRENCHING PLAN - SOUTH	A1-25-EE-2108
415 - 3PH. MOV WIRING DIAGRAM AND CONTROL WIRING SCHEMATIC	A1-25-EE-7515	OFFICE, CONTROL & SWITCHGEAR BUILDING POWER AND CONTROL LAYOUT	A1-25-EE-6109	LOW VOLTAGE SINGLE LINE DIAGRAM	A1-25-EE-2201
AREA LIGHTING SCHEMATIC	A1-25-EE-7519	WEST TANK FARM - SHT. 2 POWER AND CONTROL LAYOUT	A1-25-EE-6111	LOW VOLTAGE SINGLE LINE DIAGRAM	A1-25-EE-2202
TERMINAL BOX CTB-1 WIRING DIAGRAM	A1-25-EE-7601	FIRE PUMP SHELTER POWER AND CONTROL LAYOUT	A1-25-EE-6112	LOW VOLTAGE SINGLE LINE DIAGRAM	A1-25-EE-2203
TERMINAL BOX CTB-2 WIRING DIAGRAM	A1-25-EE-7602	POWER AND CONTROL DETAILS	A1-01-EE-6201	LOW VOLTAGE SINGLE LINE DIAGRAM	A1-25-EE-2204
TERMINAL BOX CTB-3 WIRING DIAGRAM	A1-25-EE-7603	TRUCK LOADING SHELTER, ISLAND #1 POWER AND CONTROL DETAILS	A1-25-EE-6202	UPS SYSTEM SINGLE LINE DIAGRAM	A1-25-EE-2206
TERMINAL BOX DTB-1 WIRING DIAGRAM	A1-25-EE-7606	TRUCK LOADING SHELTER, ISLAND #2 POWER AND CONTROL DETAILS	A1-25-EE-6203	PLANT EARTHING SYSTEM SCHEMATIC	A1-25-EE-2207
TERMINAL BOX DTB-2 WIRING DIAGRAM	A1-25-EE-7607	CABLE TRAY DETAILS	A1-01-EE-6205	AREA CLASSIFICATION PLAN NORTH	A1-25-EE-3101
TERMINAL BOX DTB-3 WIRING DIAGRAM	A1-25-EE-7608	POWER AND CONTROL CABLE SCHEDULE	A1-01-EE-6206	AREA CLASSIFICATION PLAN SOUTH	A1-25-EE-3102
TERMINAL BOX DTB-4 WIRING DIAGRAM	A1-25-EE-7609	POWER AND CONTROL CABLE SCHEDULE	A1-25-EE-6301	AREA CLASSIFICATION DETAILS	A1-25-EE-3201
TERMINAL BOX DTB-5 WIRING DIAGRAM	A1-25-EE-7610	INSTRUMENTATION DETAILS	A1-01-EE-7201	OFFICE, CONTROL AND SWGR. BLDG. AREA LIGHTING AND EARTHING LAYOUT	A1-25-EE-4101
TERMINAL BOX ATB-1 WIRING DIAGRAM	A1-25-EE-7612	INSTRUMENTATION DETAILS	A1-01-EE-7202	EAST TANK FARM - SHT. 1 LIGHTING AND EARTHING LAYOUT	A1-25-EE-4102
TERMINAL BOX KTB-1 AND KTB-2 WIRING DIAGRAM	A1-25-EE-7615	INSTRUMENTATION CABLE SCHEDULE (DISCRETE)	A1-25-EE-7301	EAST TANK FARM - SHT. 2 LIGHTING AND EARTHING LAYOUT	A1-25-EE-4103
TERMINAL BOX JB2-1A/1B, JB4-1A, JB5-1A/1B JB6-1A & JB7-1A WIRING DIAGRAM	A1-25-EE-7617	INSTRUMENTATION CABLE SCHEDULE (DISCRETE)	A1-25-EE-7302	WEST TANK FARM LIGHTING AND EARTHING LAYOUT	A1-25-EE-4104
TERMINAL BOX JB2-2A/1B, JB4-2A, JB5-2A/1B JB6-2A & JB7-2A WIRING DIAGRAM	A1-25-EE-7618	INSTRUMENTATION CABLE SCHEDULE (ANALOG)	A1-25-EE-7303	PROVER AND METERING AREA LIGHTING AND EARTHING LAYOUT	A1-25-EE-4105
NAMEPLATE SCHEDULE	A1-25-EE-9301	INSTRUMENTATION CABLE SCHEDULE (COMMUNICATION)	A1-25-EE-7304	LOADING PUMP AND MANIFOLD LIGHTING AND EARTHING LAYOUT	A1-25-EE-4106
		LOAD PUMP - MSR 25-P-01A MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7501	SEPARATOR AREA LIGHTING AND EARTHING LAYOUT	A1-25-EE-4107
		LOAD PUMP - MSR 25-P-01B MOTOR SCHEMATIC AND WIRING DIAGRAM	A1-25-EE-7502	TRUCK LOADING SHELTER AREA LIGHTING AND EARTHING LAYOUT	A1-25-EE-4108

Kenya Pipeline Company Limited 49957 ACCOUNT No 4800 SCALE N.T.S. REV 0		Propipe Lawlin International Inc DRAWING No.		WEST KENYA PIPELINE EXTENSION PROJECT NAKURU TERMINAL No. 25 DRAWING INDEX	
JOB No. 49957 ACCOUNT No 4800 SCALE N.T.S. REV 0		ENGINEER STAMP PERMIT STAMP		REVISIONS No. BY CHK LEAD SEC PRL DATE 1/11/11 ISSUED FOR APPROVAL 2/11/11 ISSUED FOR APPROVAL	
DRAWING No.		DESCRIPTION		APPROVALS DATE	

PLAN SYMBOLS

EARTHING:

- MAIN EARTH LOOP 70mm²
(ABOVE GROUND IN TRAY AS PER PLAN)
- MAIN EARTH LOOP 70mm²
- EARTH BOND WIRE 35mm²
- EARTH BOND WIRE 16mm²
- EARTHING ELECTRODE
- EARTHING RISER
- BELOW GRADE BRANCH TAP
- ABOVE GRADE BRANCH TAP
- EARTHING CABLE AND CLAMP

INSTRUMENTATION:

- ANALOG DEVICE
- DISCRETE DEVICE
- SOLENOID
- TRANSMITTER
- TRANSDUCER
- TEMPERATURE ELEMENT

FIELD INSTRUMENT TAG NUMBER AS INDICATED ON P&ID DRAWING.
EL. X INDICATES APPROX. ELEVATION
IN METERS OR MILLIMETERS.

LIGHTING:

- FIXTURE DESIGNATION
TOP INDICATES FIXTURE TYPE
BOTTOM INDICATES FIXTURE SCHEDULE DRAWING
- LIGHTING FIXTURE PENDANT OR CEILING MOUNT
- LIGHTING FIXTURE WALL MOUNTED
- SURFACE OR PENDANT MOUNTED FLUORESCENT LIGHT FIXTURE
- RECESSED FLUORESCENT FIXTURE
- ROTATING BEACON (R=RED LIGHT)
- STROBE BEACON
- FLOODLIGHT TOWER

EMERGENCY POWER PACK

EXIT LIGHT

SINGLE RECEPTACLE 1 Ø. 13A, 240 VOLT
SUITABLE FOR ZONE 1

DUPLEX RECEPTACLE 1 Ø. 13A, 240 VOLT
UNCLASSIFIED (INDOOR USE)

POWER RECEPTACLE, WEATHERPROOF
415V, 3 Ø, 30A, METAL CLAD

S₁ SINGLE POLE SWITCH

S₂ 2-WAY SWITCH

LP-LIGHTING PANEL

TELEPHONE CABINET

GENERAL:

DETAIL OR MATERIAL DESIGNATION
TOP INDICATES DETAIL NUMBER
BOTTOM INDICATES THE DRAWING NUMBER
TYPE X INDICATES THE NUMBER OF PLACES

DISCONNECT

JUNCTION BOX

HERN

FIRE ALARM STATION

TRANSFORMER

MOTOR

PHOTOCELL

VIBRATION SWITCH

JUNCTION BOX

CONTROL STATION AS SPECIFIED

TELEPHONE OUTLET

MANUAL MOTOR STARTING SWITCH
WITH THERMAL OVERLOAD PROTECTION

THERMOSTAT

CONDUIT/CABLE EXPOSED

CONDUIT CAPPED

CONDUIT UNION

CONDUIT SEAL

CONDUIT FITTING AS REQUIRED

BURIED CABLE

EMERGENCY SHUT-DOWN BUTTON

- FIELD TERMINAL BOX (FTB)
- ATB-X ANALOG TERMINAL BOX
- CTB-X CONTROL TERMINAL BOX (ADV)
- DTB-X DISCRETE TERMINAL BOX
- MTB-X COMMUNICATION (LOOP) TERMINAL BOX

ANALOG CABLE

CONTROL CABLE

DISCRETE CABLE

FIRE ALARM CABLE

COMMUNICATION CABLE

RTD CABLE

POWER CABLE

BRANCH CIRCUIT FEEDER FROM LIGHTING PANEL


BRANCH CIRCUIT FEEDER FROM DISTRIBUTION PANEL

BRANCH CIRCUIT FEEDER FROM UPS PANEL

EMERGENCY SHUT-DOWN CONTROL CABLE

Propipe Kenya Pipeline Company Limited		JOB No 49957
Kenya Pipeline Company Limited		ACCOUNT No 4800
West Kenya Pipeline Extension Project		SCALE NTS
NAKURU TERMINAL No. 25		REV D
PLAN SYMBOLS		DRAWING No
REVISIONS		
NO	BY	CHK
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		
65		
66		
67		
68		
69		
70		
71		
72		
73		
74		
75		
76		
77		
78		
79		
80		
81		
82		
83		
84		
85		
86		
87		
88		
89		
90		
91		
92		
93		
94		
95		
96		
97		
98		
99		
100		
101		
102		
103		
104		
105		
106		
107		
108		
109		
110		
111		
112		
113		
114		
115		
116		
117		
118		
119		
120		
121		
122		
123		
124		
125		
126		
127		
128		
129		
130		
131		
132		
133		
134		
135		
136		
137		
138		
139		
140		
141		
142		
143		
144		
145		
146		
147		
148		
149		
150		
151		
152		
153		
154		
155		
156		
157		
158		
159		
160		
161		
162		
163		
164		
165		
166		
167		
168		
169		
170		
171		
172		
173		
174		
175		
176		
177		
178		
179		
180		
181		
182		
183		
184		
185		
186		
187		
188		
189		
190		
191		
192		
193		
194		
195		
196		
197		
198		
199		
200		
201		
202		
203		
204		
205		
206		
207		
208		
209		
210		
211		
212		
213		
214		
215		
216		
217		
218		
219		
220		
221		
222		
223		
224		
225		
226		
227		
228		
229		
230		
231		
232		
233		
234		
235		
236		
237		
238		
239		
240		
241		
242		
243		
244		
245		
246		
247		
248		
249		
250		
251		
252		
253		
254		
255		
256		
257		
258		
259		
260		
261		
262		
263		
264		
265		
266		
267		
268		
269		
270		
271		
272		
273		
274		
275		
276		
277		
278		
279		
280		
281		
282		
283		
284		
285		
286		
287		
288		
289		
290		
291		
292		
293		
294		
295		
296		
297		
298		
299		
300		
301		
302		
303		
304		
305		
306		
307		
308		
309		
310		
311		
312		
313		
314		
315		
316		
317		
318		
319		
320		
321		
322		
323		
324		
325		
326		
327		
328		
329		
330		
331		
332		
333		
334		
335		
336		
337		
338		
339		
340		
341		
342		
343		
344		
345		
346		
347		
348		
349		
350		
351		
352		
353		
354		
355		
356		
357		
358		
359		
360		
361		
362		
363		


SINGLE LINE AND SCHEMATIC SYMBOLS

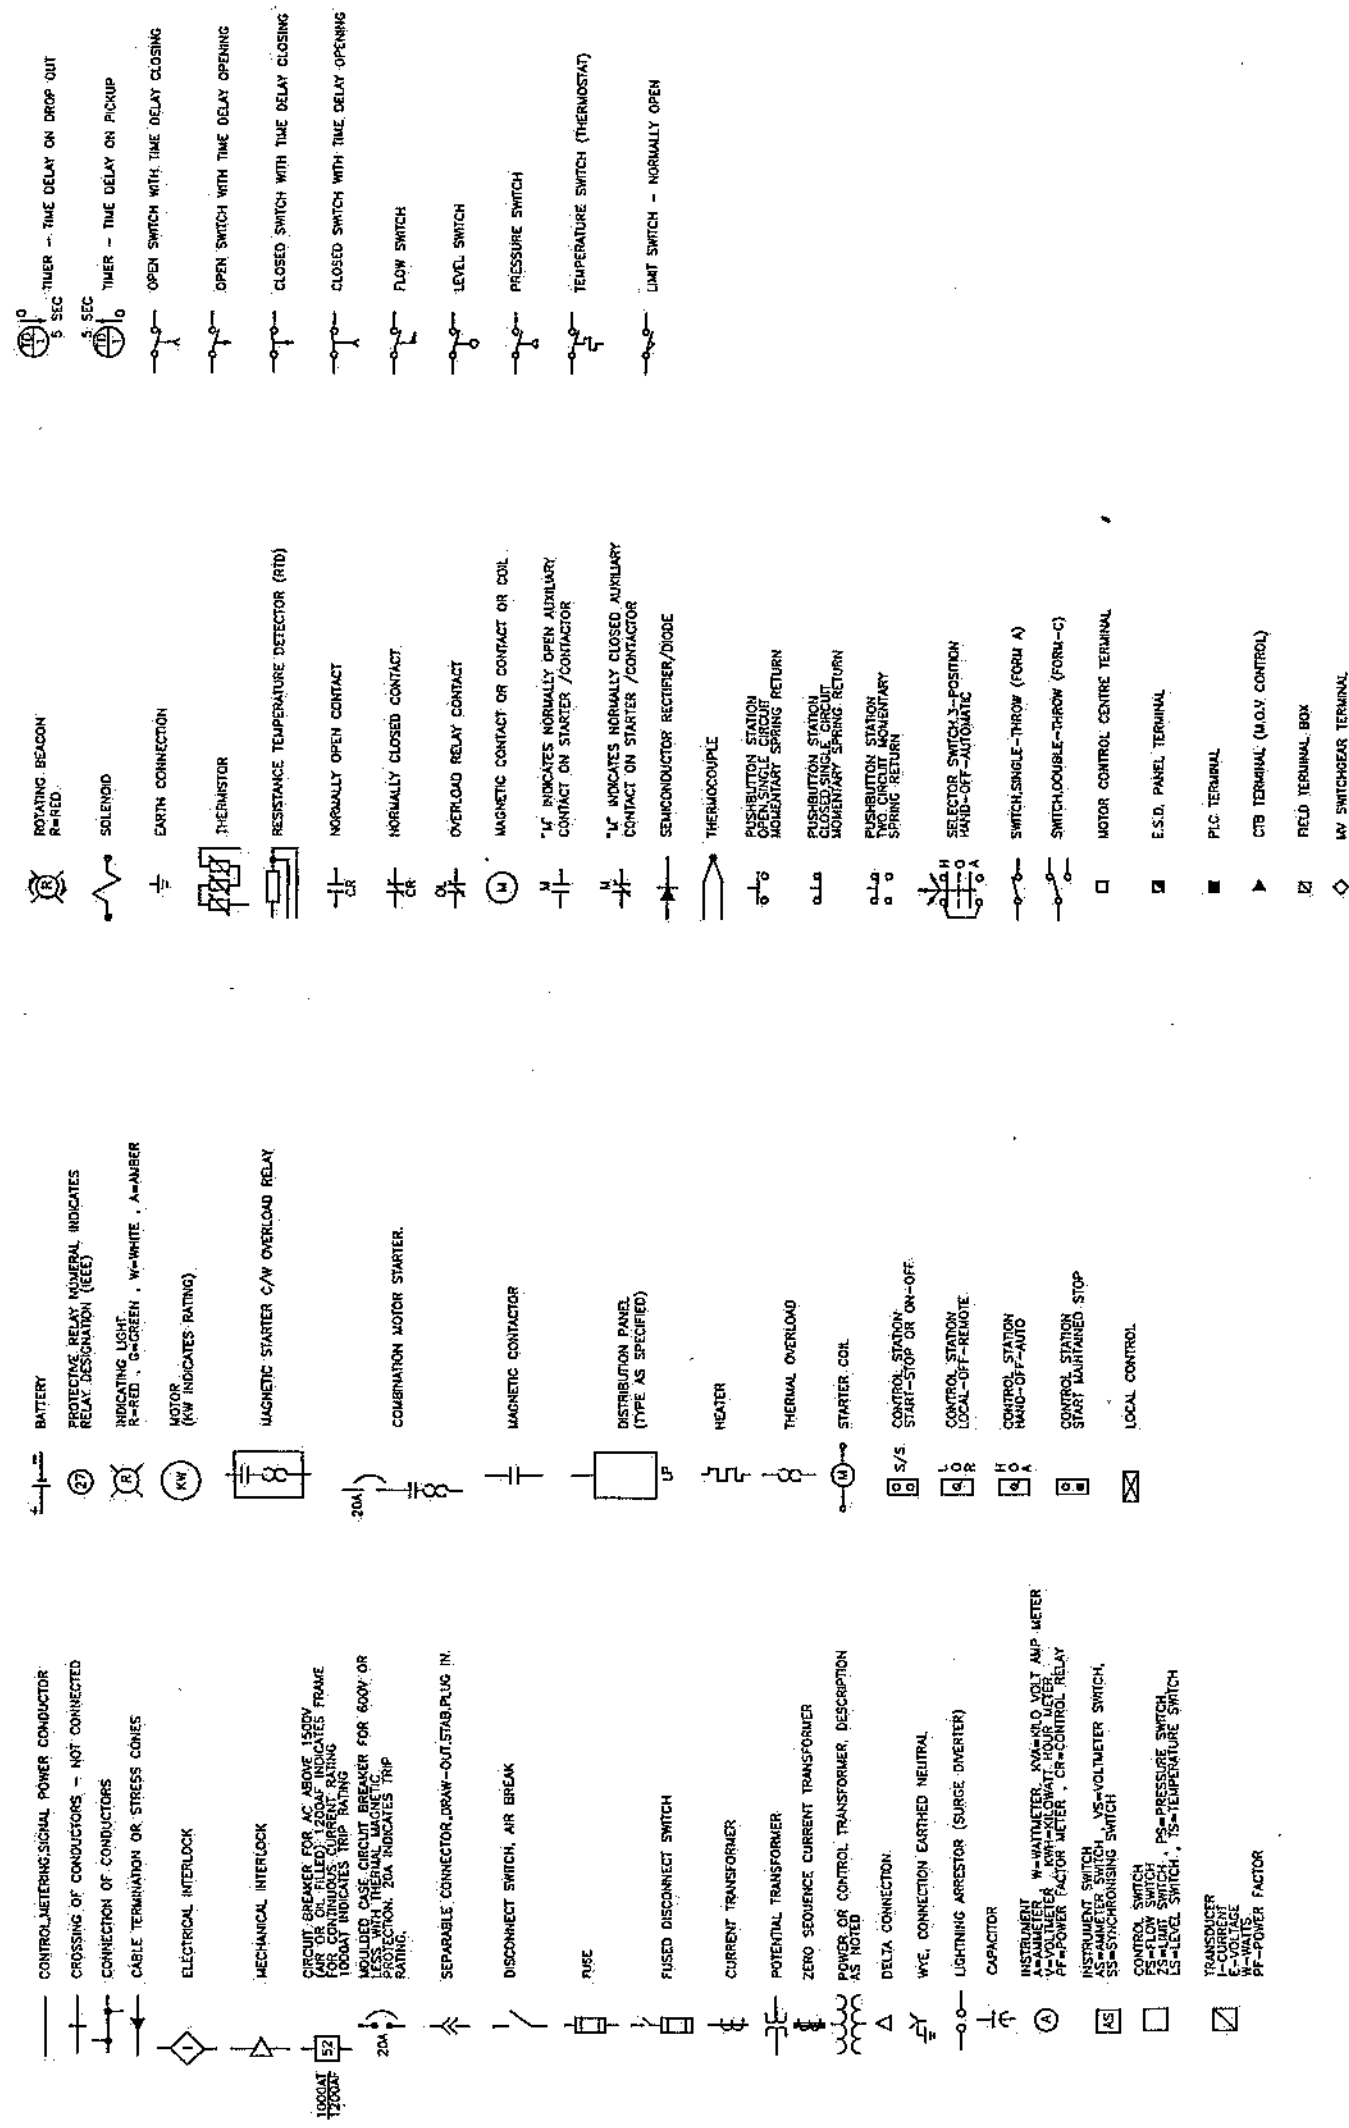[illegible]




PLANT NORTH



MATCHLINE S. 163.000 FOR CONTINUATION SEE DWG. No. A1-25-EE-2103

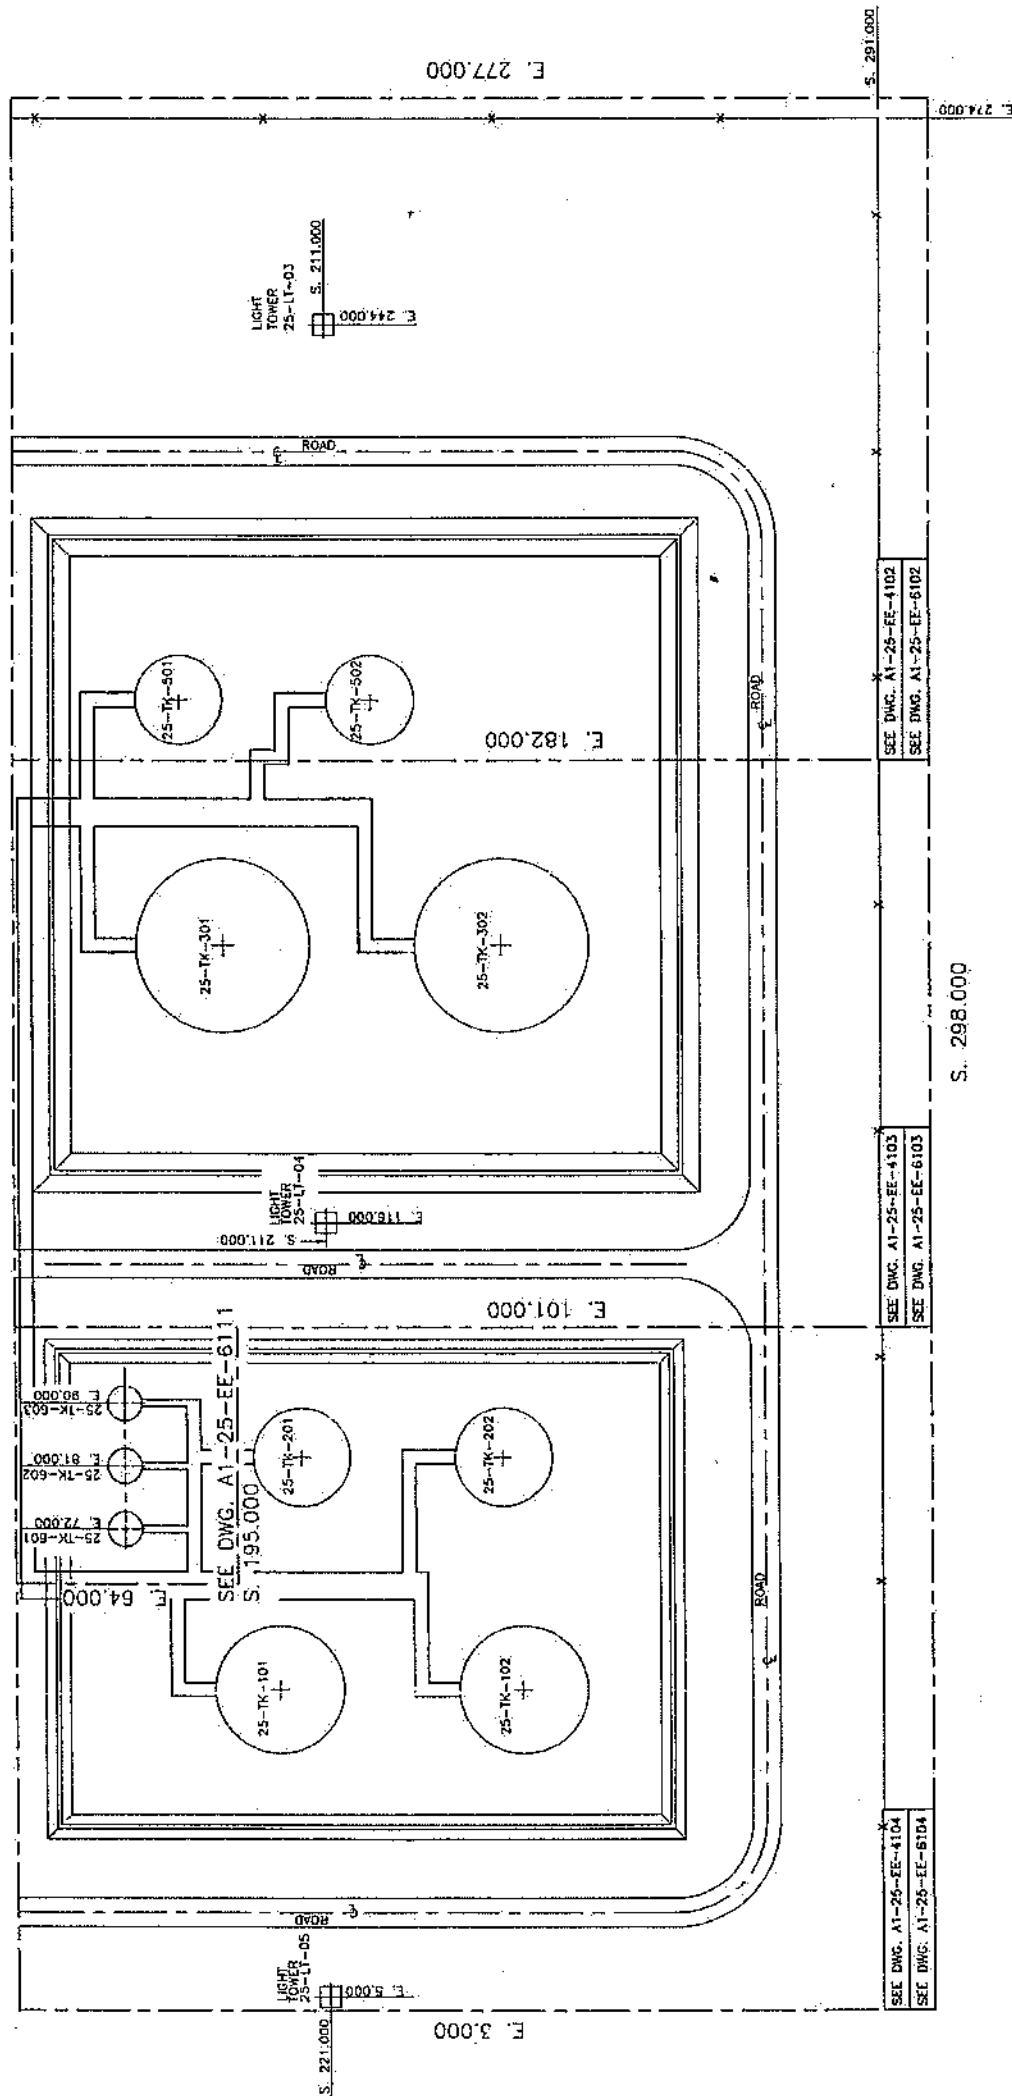

RECEIVED
19 MAR 1993
LAVANIN CORPORATION

JOB No. 49957		ACCOUNT No. 4600		SCALE 1:500		REV 1	
KENYA PIPELINE COMPANY LIMITED		WEST KENYA PIPELINE EXTENSION PROJECT NAKURU TERMINAL No. 25 KEY PLAN SOUTH					
Propipe		Lavanin International Inc					
DRAWING No.		PERMIT STAMP					
ENGINEER STAMP		APPROVALS					
DESIGN		CHECKED		DATE		DATE	
DRAWN		CHECKED		DATE		DATE	
DESIGNED		CHECKED		DATE		DATE	
LEAD		CHECKED		DATE		DATE	
PROJECT		CHECKED		DATE		DATE	
CONSTRUCTION		CHECKED		DATE		DATE	
ISSUED FOR CONSTRUCTION		CHECKED		DATE		DATE	
ISSUED FOR APPROVAL		CHECKED		DATE		DATE	
REVISIONS		REVISIONS		REVISIONS		REVISIONS	
No.		By		Date		Date	
1		25		09/04/93		09/04/93	
2		25		09/04/93		09/04/93	
3		25		09/04/93		09/04/93	
4		25		09/04/93		09/04/93	
5		25		09/04/93		09/04/93	
6		25		09/04/93		09/04/93	
7		25		09/04/93		09/04/93	
8		25		09/04/93		09/04/93	
9		25		09/04/93		09/04/93	
10		25		09/04/93		09/04/93	
11		25		09/04/93		09/04/93	
12		25		09/04/93		09/04/93	
13		25		09/04/93		09/04/93	
14		25		09/04/93		09/04/93	
15		25		09/04/93		09/04/93	
16		25		09/04/93		09/04/93	
17		25		09/04/93		09/04/93	
18		25		09/04/93		09/04/93	
19		25		09/04/93		09/04/93	
20		25		09/04/93		09/04/93	
21		25		09/04/93		09/04/93	
22		25		09/04/93		09/04/93	
23		25		09/04/93		09/04/93	
24		25		09/04/93		09/04/93	
25		25		09/04/93		09/04/93	
26		25		09/04/93		09/04/93	
27		25		09/04/93		09/04/93	
28		25		09/04/93		09/04/93	
29		25		09/04/93		09/04/93	
30		25		09/04/93		09/04/93	
31		25		09/04/93		09/04/93	
32		25		09/04/93		09/04/93	
33		25		09/04/93		09/04/93	
34		25		09/04/93		09/04/93	
35		25		09/04/93		09/04/93	
36		25		09/04/93		09/04/93	
37		25		09/04/93		09/04/93	
38		25		09/04/93		09/04/93	
39		25		09/04/93		09/04/93	
40		25		09/04/93		09/04/93	
41		25		09/04/93		09/04/93	
42		25		09/04/93		09/04/93	
43		25		09/04/93		09/04/93	
44		25		09/04/93		09/04/93	
45		25		09/04/93		09/04/93	
46		25		09/04/93		09/04/93	
47		25		09/04/93		09/04/93	
48		25		09/04/93		09/04/93	
49		25		09/04/93		09/04/93	
50		25		09/04/93		09/04/93	
51		25		09/04/93		09/04/93	
52		25		09/04/93		09/04/93	
53		25		09/04/93		09/04/93	
54		25		09/04/93		09/04/93	
55		25		09/04/93		09/04/93	
56		25		09/04/93		09/04/93	
57		25		09/04/93		09/04/93	
58		25		09/04/93		09/04/93	
59		25		09/04/93		09/04/93	
60		25		09/04/93		09/04/93	
61		25		09/04/93		09/04/93	
62		25		09/04/93		09/04/93	
63		25		09/04/93		09/04/93	
64		25		09/04/93		09/04/93	
65		25		09/04/93		09/04/93	
66		25		09/04/93		09/04/93	
67		25		09/04/93		09/04/93	
68		25		09/04/93		09/04/93	
69		25		09/04/93		09/04/93	
70		25		09/04/93		09/04/93	
71		25		09/04/93		09/04/93	
72		25		09/04/93		09/04/93	
73		25		09/04/93		09/04/93	
74		25		09/04/93		09/04/93	
75		25		09/04/93		09/04/93	
76		25		09/04/93		09/04/93	
77		25		09/04/93		09/04/93	
78		25		09/04/93		09/04/93	
79		25		09/04/93		09/04/93	
80		25		09/04/93		09/04/93	
81		25		09/04/93		09/04/93	
82		25		09/04/93		09/04/93	
83		25		09/04/93		09/04/93	
84		25		09/04/93		09/04/93	
85		25		09/04/93		09/04/93	
86		25		09/04/93		09/04/93	
87		25		09/04/93		09/04/93	
88		25		09/04/93		09/04/93	
89		25		09/04/93		09/04/93	
90		25		09/04/93		09/04/93	
91		25		09/04/93		09/04/93	
92		25		09/04/93		09/04/93	
93		25		09/04/93		09/04/93	
94		25		09/04/93		09/04/93	
95		25		09/04/93		09/04/93	
96		25		09/04/93		09/04/93	
97		25		09/04/93		09/04/93	
98		25		09/04/93		09/04/93	
99		25		09/04/93		09/04/93	
100		25		09/04/93		09/04/93	
101		25		09/04/93		09/04/93	
102		25		09/04/93		09/04/93	
103		25		09/04/93		09/04/93	
104		25		09/04/93		09/04/93	
105		25		09/04/93		09/04/93	
106		25		09/04/93		09/04/93	
107		25		09/04/93		09/04/93	
108		25		09/04/93		09/04/93	
109		25		09/04/93		09/04/93	
110		25		09/04/93		09/04/93	
111		25		09/04/93		09/04/93	
112		25		09/04/93		09/04/93	
113		25		09/04/93		09/04/93	
114		25		09/04/93		09/04/93	
115		25		09/04/93		09/04/93	
116		25		09/04/93		09/04/93	
117		25		09/04/93		09/04/93	
118		25		09/04/93		09/04/93	
119		25		09/04/93		09/04/93	
120		25		09/04/93		09/04/93	
121		25		09/04/93		09/04/93	
122		25		09/04/93		09/04/93	
123		25		09/04/93		09/04/93	
124		25		09/04/93		09/04/93	
125		25		09/04/93		09/04/93	
126		25		09/04/93		09/04/93	
127		25		09/04/93		09/04/93	
128		25		09/04/93		09/04/93	
129		25		09/04/93		09/04/93	
130		25		09/04/93		09/04/93	
131		25		09/04/93		09/04/93	
132		25		09/04/93		09/04/93	
133		25		09/04/93		09/04/93	
134		25		09/04/93		09/04/93	
135		25		09/04/93		09/04/93	
136		25		09/04/93		09/04/93	
137		25		09/04/93		09/04/93	
138		25		09/04/93		09/04/93	
139		25		09/04/93		09/04/93	
140		25		09/04/93		09/04/93	
141		25		09/04/93		09/04/93	
142		25		09/04/93		09/04/93	
143		25		09/04/93		09/04/93	
144		25		09/04/93		09/04/93	
145		25		09/04/93		09/04/93	
146		25		09/04/93		09/04/93	
147		25		09/04/93		09/04/93	
148		25		09/04/93		09/04/93	
149		25		09/04/93		09/04/93	
150		25		09/04/93		09/04/93	
151		25		09/04/93		09/04/93	
152		25		09/04/93		09/04/93	
153		25		09/04/93		09/04/93	
154		25		09/04/93		09/04/93	
155		25		09/04/93		09/04/93	
156		25		09/04/93		09/04/93	
157		25		09/04/93		09/04/93	
158		25		09/04/93		09/04/93	
159		25		09/04/93		09/04/93	
160		25		09/04/93		09/04/93	
161		25		09/04/93		09/04/93	
162		25		09/04/93		09/04/93	
163		25		09/04/93		09/04/93	
164		25		09/04/93		09/04/93	
165		25		09/04/93		09/04/93	
166		25		09/04/93		09/04/93	
167		25		09/04/93		09/04/93	
168		25		09/04/93		09/04/93	
169		25		09/04/93		09/04/93	
170		25		09/04/93		09/04/93	
171		25		09/04/93		09/04/93	
172		25		09/04/93		09/04/93	
173		25		09/04/93		09/04/93	
174		25		09/04/93		09/04/93	
175		25		09/04/93		09/04/93	
176		25		09/04/93		09/04/93	
177		25		09/04/93		09/04/93	
178		25		09/04/93		09/04/93	
179		25		09/04/93		09/04/93	
180		25		09/04/93		09/04/93	
181		25		09/04/93		09/04/93	
182		25		09/04/93		09/04/93	
183		25		09/04/93		09/04/93	
184		25		09/04/93		09/04/93	
185		25		09/04/93		09/04/93	
186		25		09/04/93		09/04/93	
187		25		09/04/93		09/04/93	
188		25		09/04/93		09/04/93	
189		25		09/04/93		09/04/93	
190		25		09/04/93		09/04/93	
191		25		09/04/93		09/04/93	
192		25		09/04/93		09/04/93	
193		25		09/04/93		09/04/93	
194		25		09/04/93		09/04/93	
195		25		09/04/93		09/04/93	
196		25		09/04/93		09/04/93	
197		25		09/04/93		09/04/93	
198		25					

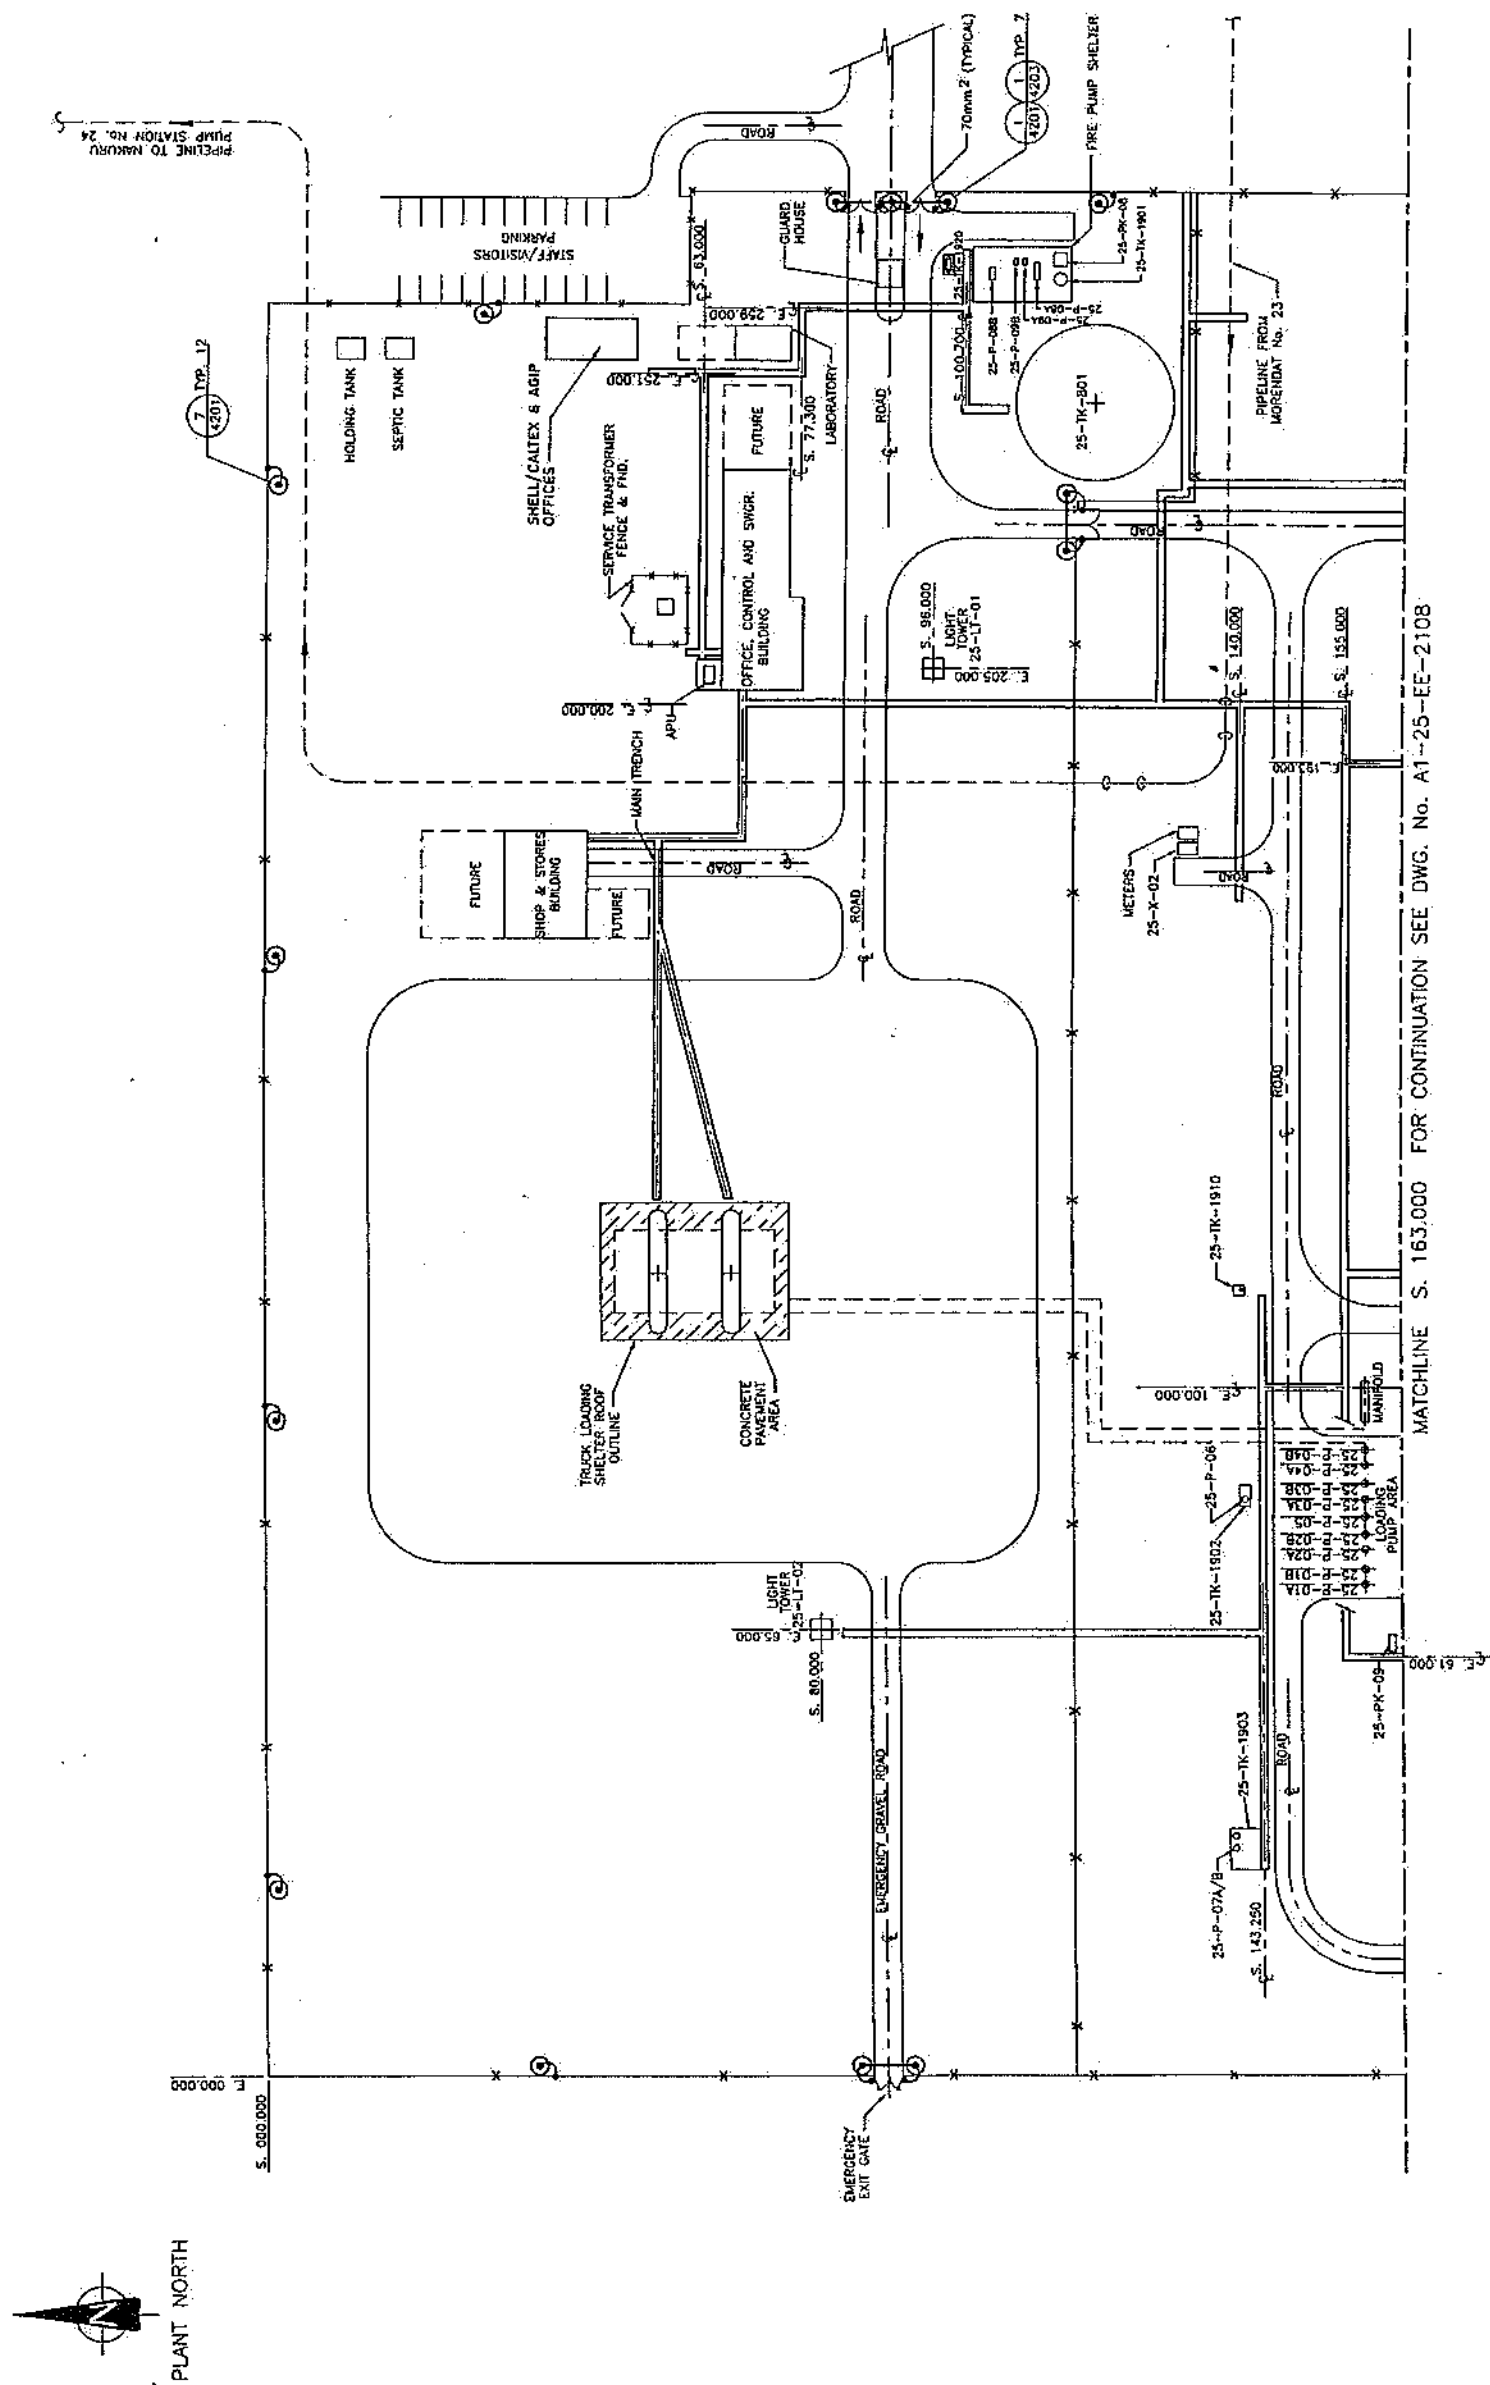
[illegible]

Plotted Date 1993-02-01 15:03:

LEGEND

- GENERATOR
- POWER FACTOR METER
- DIGITAL METERING SYSTEM
- KVA DEMAND METER
- VOLTMETER
- AMPMETER
- FREQUENCY METER
- AMMETER SWITCH
- VOLTMETER SWITCH
- VOLTAGE REGULATOR
- RED - INDICATES CLOSED/RUNNING
- GREEN - INDICATES OPEN/STOPPED
- AMBER - INDICATES MOTOR TRIPPED
- WHITE - INDICATES SUPPLY ON
- INTERLOCK
- PLC INPUT/OUTPUT
- HAND OFF AUTO SELECTOR SWITCH
- LOCAL OFF REMOVE SELECTOR SWITCH
- START/STOP PUSHBUTTONS
- START/STOP PUSHBUTTONS
- INDICATES MAINTAINED OFF
- THERMAL RELAY
- HEATER
- POSITIVE TEMPERATURE CO-EFFICIENT ELEMENT
- LOCAL STARTER/CONTROLLER
- PHOTO CELL
- MOTOR OPERATOR
- PRESSURE SWITCH
- LEVEL SWITCH
- THERMOSTAT
- KEY INTERLOCK
- MOTOR CIRCUIT PROTECTOR (MAGNETIC TRIP ONLY)
- SOLID STATE TRIP UNIT
- 3 POLE BREAKER WITH NEUTRAL DISCONNECT

415V MCC 25-E-04

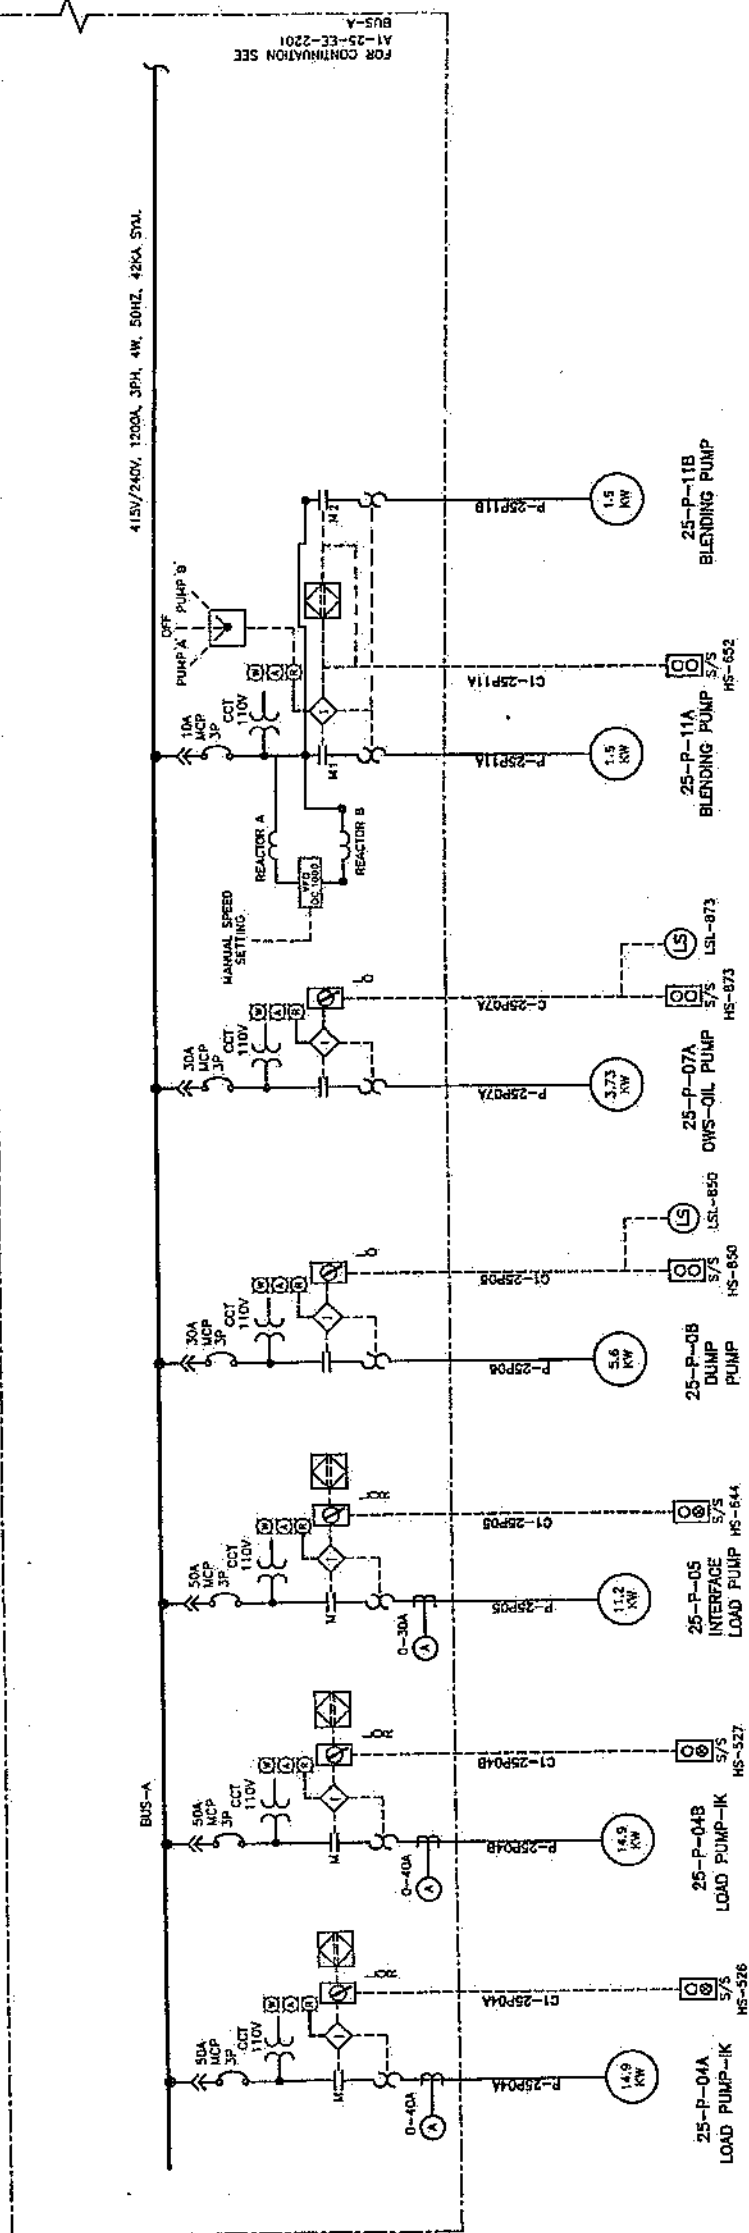



KENYA PIPELINE COMPANY LIMITED		Propipe		ENGINEER STAMP		PERMIT STAMP	
JOB No	49957	ACCOUNT No	1600	DESIGN	REVISION	DATE	DATE
SCALE	N.T.S	PROJECT	WEST KENYA PIPELINE EXTENSION PROJECT	DESIGNED	REVISION	DATE	DATE
REV	6	DRAWING No	NAKURU TERMINAL No 25	DRAWN	REVISION	DATE	DATE
LOW VOLTAGE SINGLE LINE DIAGRAM				CHECKED	REVISION	DATE	DATE
DWG No AT-25-EE-2202				APPROVED	REVISION	DATE	DATE
Filename : 25EE2202				DATE	DATE	DATE	DATE



REV	DATE	DESCRIPTION
1	01.02.20	ISSUE FOR DESIGN APPROVAL
2	01.02.20	ISSUE FOR CLIENT APPROVAL/QUOTE
3	01.02.20	ISSUE FOR CONSTRUCTION
4	01.02.20	ISSUE FOR CONSTRUCTION
5	01.02.20	ISSUE FOR CONSTRUCTION
6	01.02.20	ISSUE FOR CONSTRUCTION

REV	DATE	DESCRIPTION
1	01.02.20	ISSUE FOR DESIGN APPROVAL
2	01.02.20	ISSUE FOR CLIENT APPROVAL/QUOTE
3	01.02.20	ISSUE FOR CONSTRUCTION
4	01.02.20	ISSUE FOR CONSTRUCTION
5	01.02.20	ISSUE FOR CONSTRUCTION
6	01.02.20	ISSUE FOR CONSTRUCTION

REV	DATE	DESCRIPTION
1	01.02.20	ISSUE FOR DESIGN APPROVAL
2	01.02.20	ISSUE FOR CLIENT APPROVAL/QUOTE
3	01.02.20	ISSUE FOR CONSTRUCTION
4	01.02.20	ISSUE FOR CONSTRUCTION
5	01.02.20	ISSUE FOR CONSTRUCTION
6	01.02.20	ISSUE FOR CONSTRUCTION

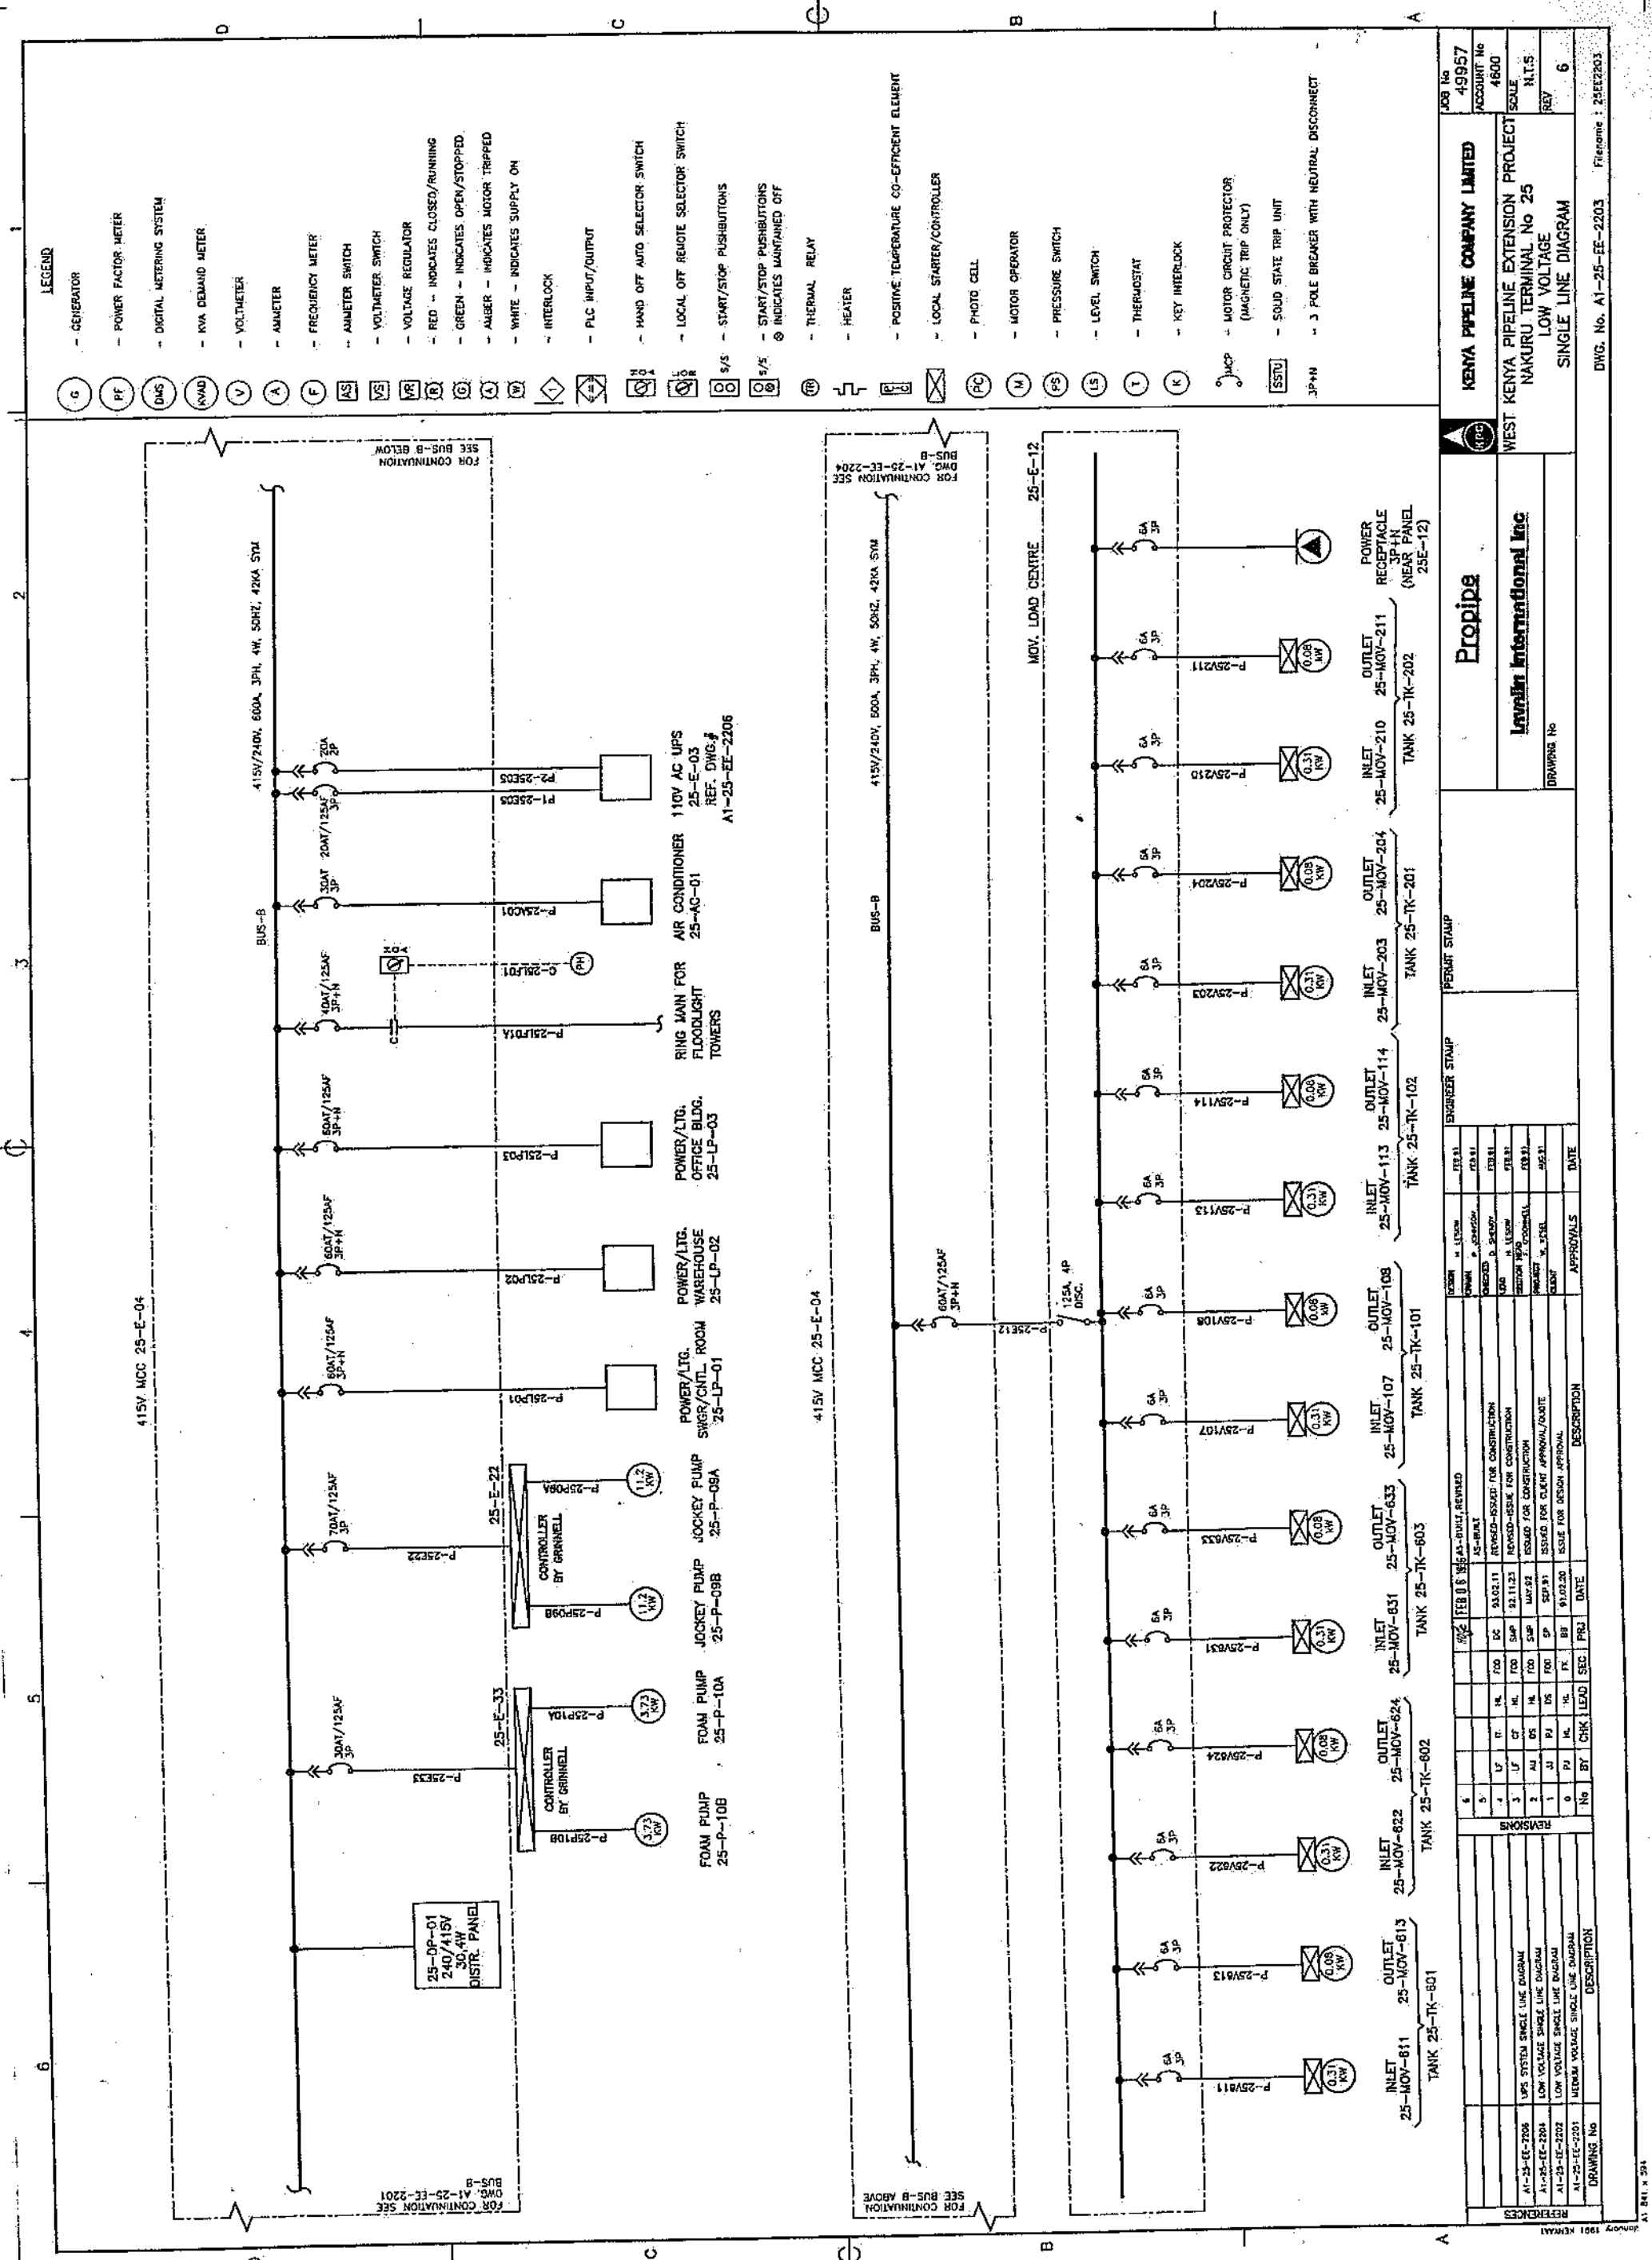

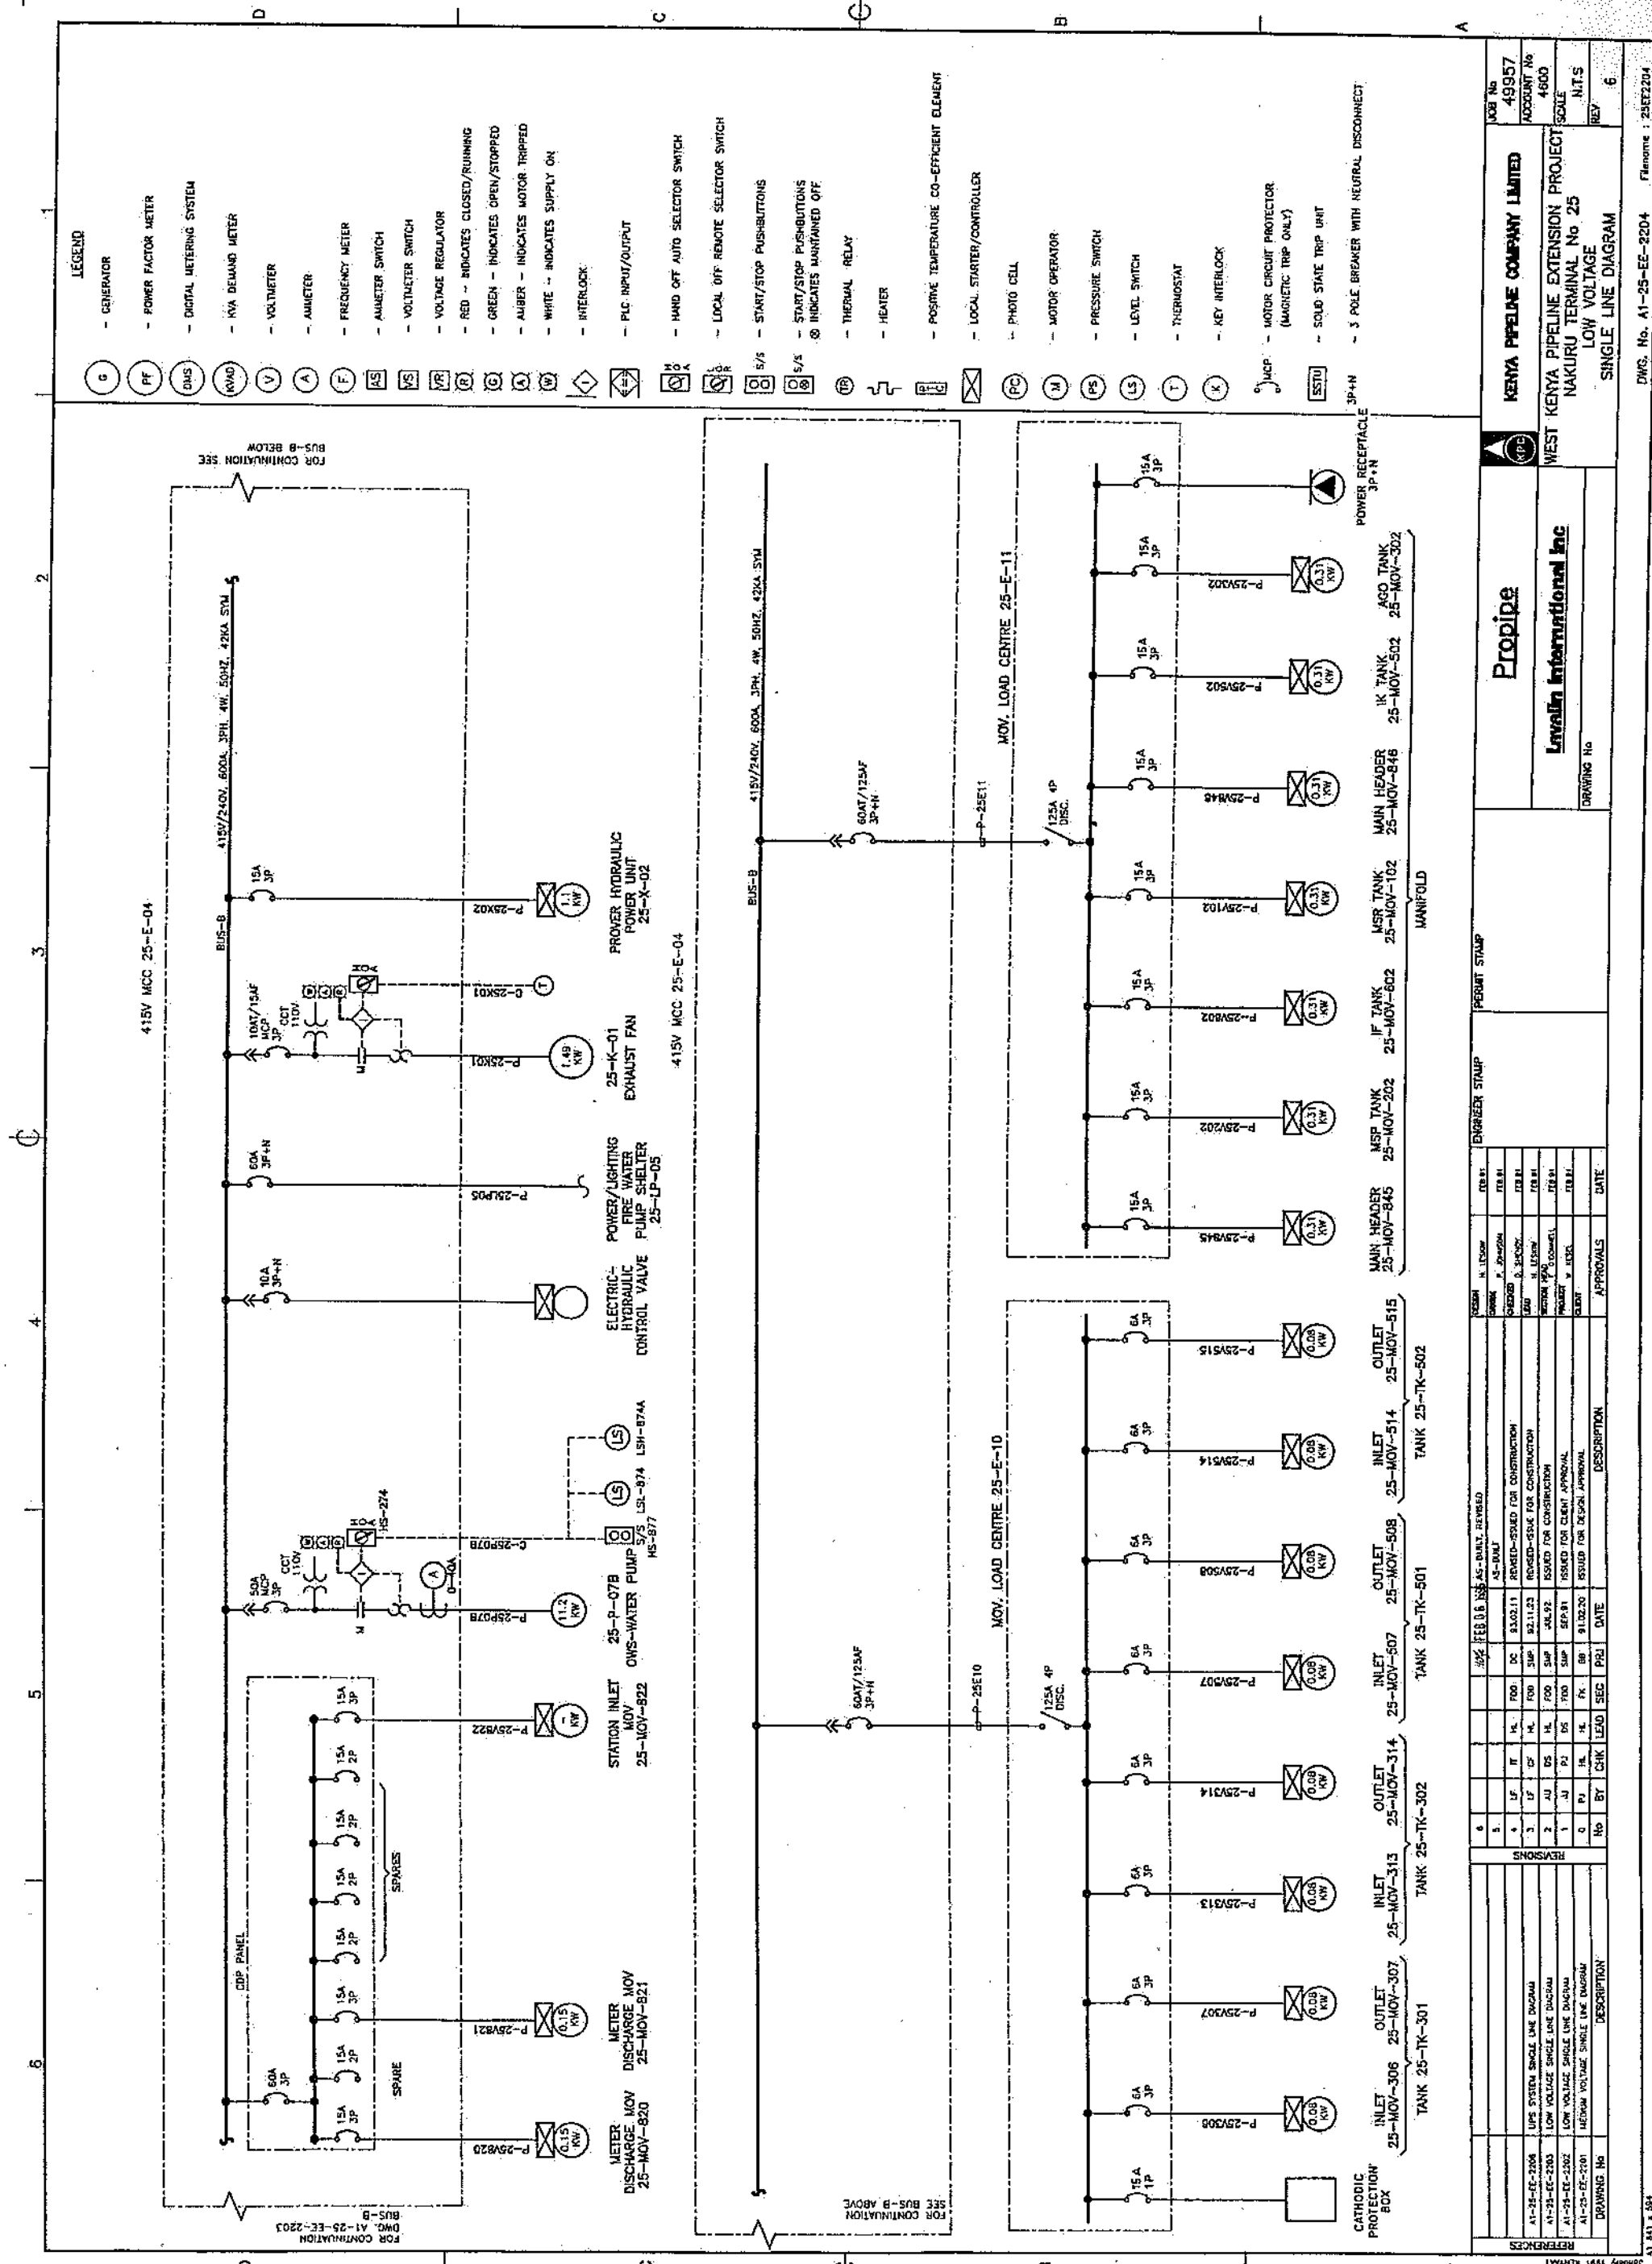

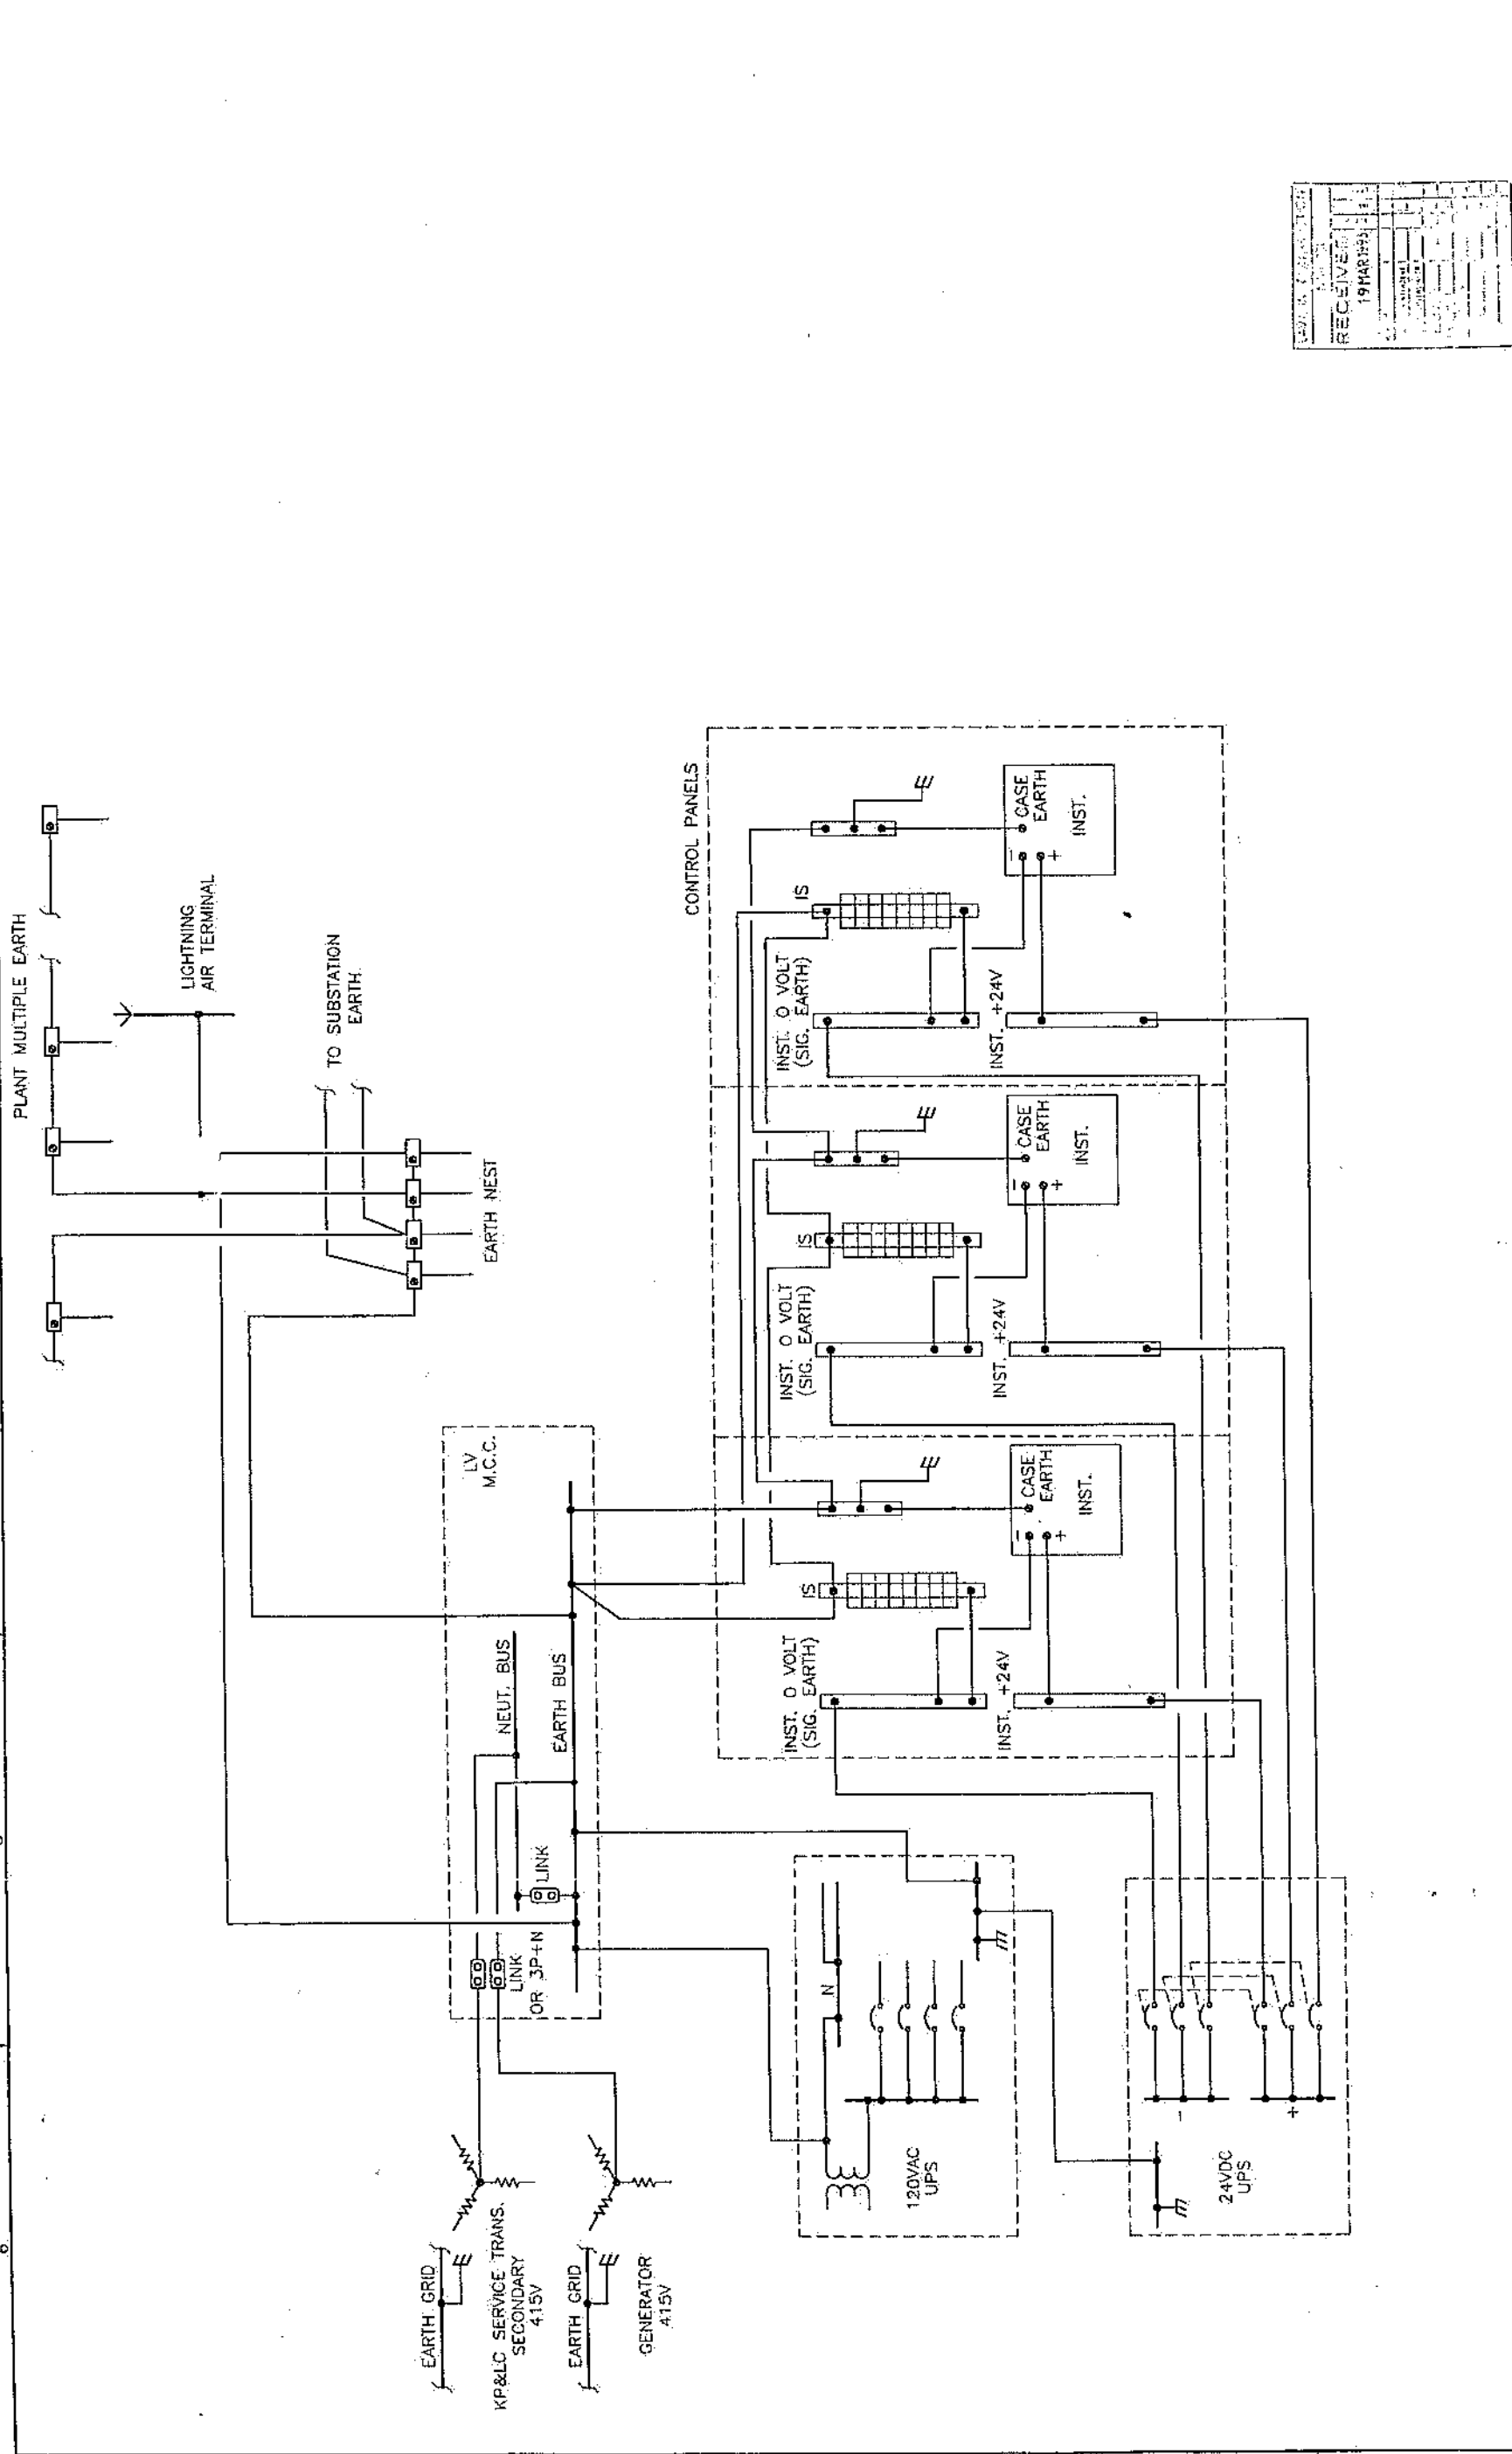

KENYA PIPELINE COMPANY LIMITED WEST KENYA PIPELINE EXTENSION PROJECT NAKURU TERMINAL No. 25 PLANT EARTHING SYSTEM SCHEMATIC		JOB No. 49957 ACCOUNT No. 4600 SCALE: INTS REV: 1					
Propipe Lavadin International Inc		DRAWING No.					
PERMIT STAMP							
ENGINEER STAMP							
REVISIONS							
No.	BY	CHK	LEAD	SEC	PRJ	DATE	DESCRIPTION
1	AS	AS	AS	AS	AS	12/11/92	ISSUED FOR CONSTRUCTION
2	AS	AS	AS	AS	AS	12/11/92	ISSUE FOR APPROVAL
3	AS	AS	AS	AS	AS	12/11/92	
4	AS	AS	AS	AS	AS	12/11/92	
5	AS	AS	AS	AS	AS	12/11/92	
6	AS	AS	AS	AS	AS	12/11/92	
APPROVALS							
DATE							
DESCRIPTION							
DRAWING No.							


DWG. No. A1-25-EE-2207 File name: 25EE2207



PLANT NORTH

S. 000.000
000.000

LEGEND



NOTES:

1. AREA CLASSIFICATIONS ARE TO IP MODEL CODE OF SAFE PRACTICE, PART 15
 2. IEC EQUIPMENT CLASSIFICATIONS FOR USE IN THE RESPECTIVE ZONES IS LISTED BELOW. ELECTRICAL MATERIAL AND METHOD OF INSTALLATION SHALL BE IN ACCORDANCE WITH THE INSTITUTE OF PETROLEUM (IP) MODEL CODE OF SAFE PRACTICE, PART 1 FOR THE RESPECTIVE ZONE.
 3. CS/VLL CERTIFIED EQUIPMENT CLASSIFICATIONS FOR USE IN THE RESPECTIVE ZONES IS SHOWN IN BRACKETS.
- ZONE 0
EQUIPMENT TO CLASSIFICATION Ex 1 a (INTRINSICALLY SAFE)
- ZONE 1
EQUIPMENT TO CLASSIFICATION Ex d MEX (CLASS 1, DIV 1, GROUP D T3)
- ZONE 2
EQUIPMENT TO CLASSIFICATION Ex e/Ex n MEX (CLASS 1, DIV 2, GROUP D T3)

PIPELINE TO NAKURU
PUMP STATION No. 24

HOLDING TANK
SEPTIC TANK

MAINT. TRENCH
APU

TRUCK LOADING
SHELTER ROOF
OUTLINE

CONCRETE
PAVEMENT
AREA

EMERGENCY
EXIT GATE
S. 80.000
LIGHT
TOWER

LABORATORY
OFFICE, CONTROL AND SHGR.
BUILDING SEE DWG'S.

STAFF/VISITORS
PARKING

GUARD HOUSE

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

ROAD

25-TK-1902

25-TK-1903

25-TK-1904

25-TK-1905

25-TK-1906

25-TK-1907

25-TK-1908

25-TK-1909

25-TK-1910

25-TK-1911

25-TK-1912

25-TK-1913

25-TK-1914

25-TK-1915

25-TK-1916

25-TK-1917

25-TK-1918

25-TK-1919

25-TK-1920

25-TK-1921

25-TK-1922

25-TK-1923

25-TK-1924

25-TK-1925

25-TK-1926

25-TK-1927

25-TK-1928

25-TK-1929

25-TK-1930

25-TK-1931

25-TK-1932

25-TK-1933

25-TK-1934

25-TK-1935

25-TK-1936

25-TK-1937

25-TK-1938

25-TK-1939

25-TK-1940

25-TK-1941

25-TK-1942

25-TK-1943

25-TK-1944

25-TK-1945

25-TK-1946

25-TK-1947

25-TK-1948

25-TK-1949

25-TK-1950

25-TK-1951

25-TK-1952

25-TK-1953

25-TK-1954

25-TK-1955

25-TK-1956

25-TK-1957

25-TK-1958

25-TK-1959

25-TK-1960

25-TK-1961

25-TK-1962

25-TK-1963

25-TK-1964

25-TK-1965

25-TK-1966

25-TK-1967

25-TK-1968

25-TK-1969

25-TK-1970

25-TK-1971

25-TK-1972

25-TK-1973

25-TK-1974

25-TK-1975

25-TK-1976

25-TK-1977

25-TK-1978

25-TK-1979

25-TK-1980

25-TK-1981

25-TK-1982

25-TK-1983

25-TK-1984

25-TK-1985

25-TK-1986

25-TK-1987

25-TK-1988

25-TK-1989

25-TK-1990

25-TK-1991

25-TK-1992

25-TK-1993

25-TK-1994

25-TK-1995

25-TK-1996

25-TK-1997

25-TK-1998

25-TK-1999

25-TK-2000

25-TK-2001

25-TK-2002

25-TK-2003

25-TK-2004

25-TK-2005

25-TK-2006

25-TK-2007

25-TK-2008

25-TK-2009

25-TK-2010

25-TK-2011

25-TK-2012

25-TK-2013

25-TK-2014

25-TK-2015

25-TK-2016

25-TK-2017

25-TK-2018

25-TK-2019

25-TK-2020

25-TK-2021

25-TK-2022

25-TK-2023

25-TK-2024

25-TK-2025

25-TK-2026

25-TK-2027

25-TK-2028

25-TK-2029

25-TK-2030

25-TK-2031

25-TK-2032

25-TK-2033

25-TK-2034

25-TK-2035

25-TK-2036

25-TK-2037

25-TK-2038

25-TK-2039

25-TK-2040

25-TK-2041

25-TK-2042

25-TK-2043

25-TK-2044

25-TK-2045

25-TK-2046

25-TK-2047

25-TK-2048

25-TK-2049

25-TK-2050

25-TK-2051

25-TK-2052

25-TK-2053

25-TK-2054

25-TK-2055

25-TK-2056

25-TK-2057

25-TK-2058

25-TK-2059

25-TK-2060

25-TK-2061

25-TK-2062

25-TK-2063

25-TK-2064

25-TK-2065

25-TK-2066

25-TK-2067

25-TK-2068

25-TK-2069

25-TK-2070

25-TK-2071

25-TK-2072

25-TK-2073

25-TK-2074

25-TK-2075

25-TK-2076

25-TK-2077

25-TK-2078

25-TK-2079

25-TK-2080

25-TK-2081

25-TK-2082

25-TK-2083

25-TK-2084

25-TK-2085

25-TK-2086

25-TK-2087

25-TK-2088

25-TK-2089

25-TK-2090

25-TK-2091

25-TK-2092

25-TK-2093

25-TK-2094

25-TK-2095

25-TK-2096

25-TK-2097

25-TK-2098

25-TK-2099

25-TK-2100

25-TK-2101

25-TK-2102

25-TK-2103

25-TK-2104

25-TK-2105

25-TK-2106

25-TK-2107

25-TK-2108

25-TK-2109

25-TK-2110

25-TK-2111

25-TK-2112

25-TK-2113

25-TK-2114

25-TK-2115

25-TK-2116

25-TK-2117

25-TK-2118

25-TK-2119

25-TK-2120

25-TK-2121

25-TK-2122

25-TK-2123

25-TK-2124

25-TK-2125

25-TK-2126

25-TK-2127

25-TK-2128

25-TK-2129

25-TK-2130

25-TK-2131

25-TK-2132

25-TK-2133

25-TK-2134

25-TK-2135

25-TK-2136

25-TK-2137

25-TK-2138

25-TK-2139

25-TK-2140

25-TK-2141

25-TK-2142

25-TK-2143

25-TK-2144

25-TK-2145

25-TK-2146

25-TK-2147

25-TK-2148

25-TK-2149

25-TK-2150

25-TK-2151

25-TK-2152

25-TK-2153

25-TK-2154


25-TK-2155

25-TK-2156




PLANT NORTH

A MATCHLINE S. 163.000 FOR CONTINUATION SEE DWG. No. A1-25-EE-3101

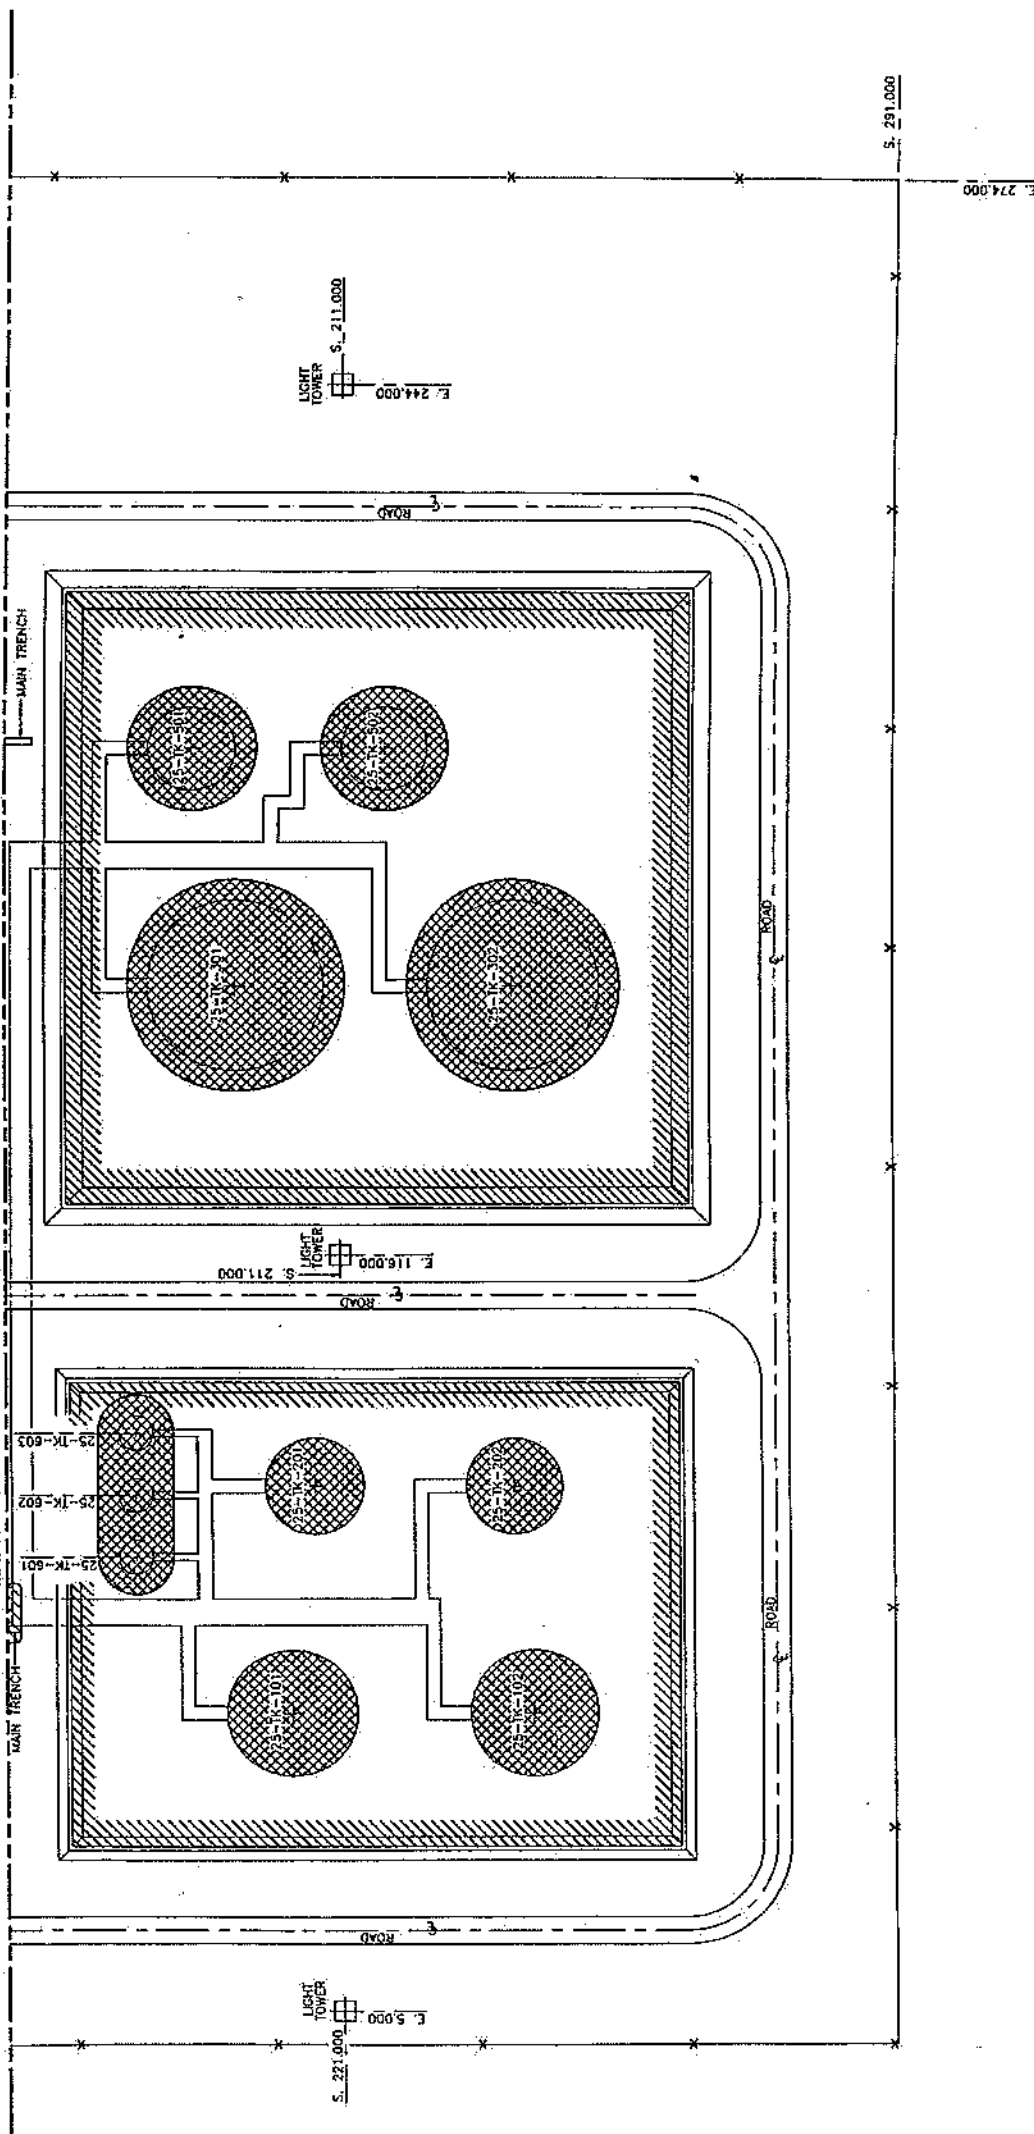

LEGEND




- NOTES:
1. AREA CLASSIFICATIONS ARE TO IP MODEL CODE OF SAFE PRACTICE, PART 15.
 2. IEC EQUIPMENT CLASSIFICATIONS FOR USE IN THE RESPECTIVE ZONES IS LISTED BELOW.
 3. CSA/UL CERTIFIED EQUIPMENT CLASSIFICATIONS FOR USE IN THE RESPECTIVE ZONES IS SHOWN IN BRACKETS.

ZONE 0
EQUIPMENT TO CLASSIFICATION Ex I a (INTRINSICALLY SAFE)


ZONE 1
EQUIPMENT TO CLASSIFICATION Ex d IAT3
(CLASS 1, DIV 1, GROUP D T3)

ZONE 2
EQUIPMENT TO CLASSIFICATION Exe/Exn IAT3
(CLASS 1, DIV 2, GROUP D T3)

KENYA PIPELINE COMPANY LIMITED		Propipe		ENGINEER STAMP		PERMIT STAMP	
JOB No	49957	DRAWING No		DATE		DATE	
ACCOUNT No	4800	SCALE		APPROVALS		APPROVALS	
WEST KENYA PIPELINE EXTENSION PROJECT		NAKURU TERMINAL No. 25		REVISIONS		REVISIONS	
AREA CLASSIFICATION PLAN		SOUTH		DESCRIPTION		DESCRIPTION	
DRAWING No		REV		No		No	
5		1:500		BY		BY	
DWG. No. A1-25-EE-3102		Filename: 25EE3102		DATE		DATE	

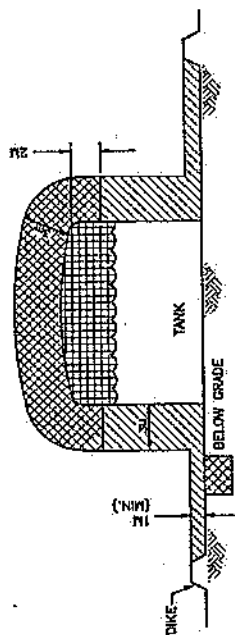


IP (PART 15) SECT. 3.2.1
IP (PART 15) SECT. 6.5.1.3

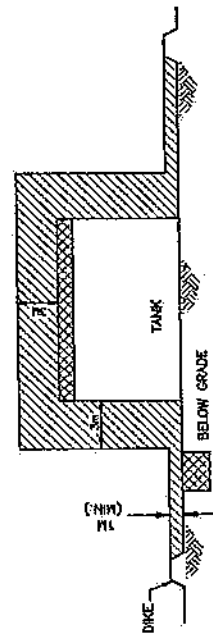


FLOATING ROOF TANK

IP (PART 15) SECT. 3.2.2
IP (PART 15) SECT. 8.5.1.3

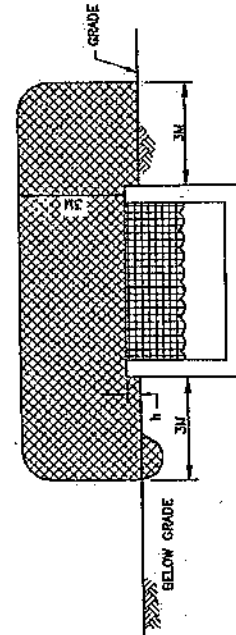


OILY WATER STORAGE TANK SECTION

IP (PART 15) SECT. 5.12
IP (PART 15) SECT. 6.5.1.3

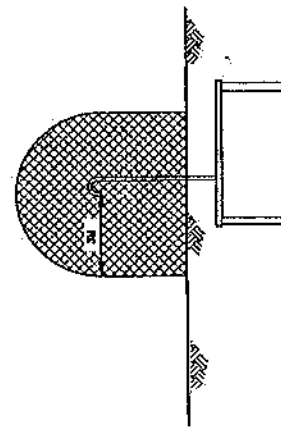


SUMP TANK VENTING

IP (PART 15) SECT. 5.12.8
IP (PART 15) SECT. 5.14

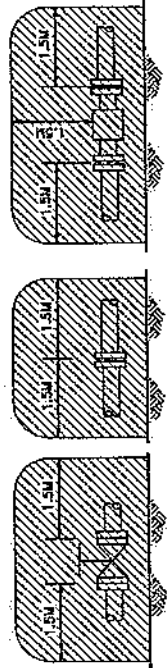


TYPICAL VALVE/FLANGE/METER LOCATION

IP (PART 15) SECT. 5.10.3
IP (PART 15) SECT. 5.10.5

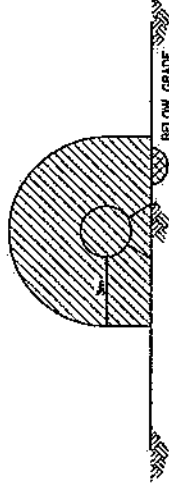


OUTDOOR PUMP.

IP (PART 15) SECT. 5.6.2
IP (PART 15) SECT. 6.5.1.3

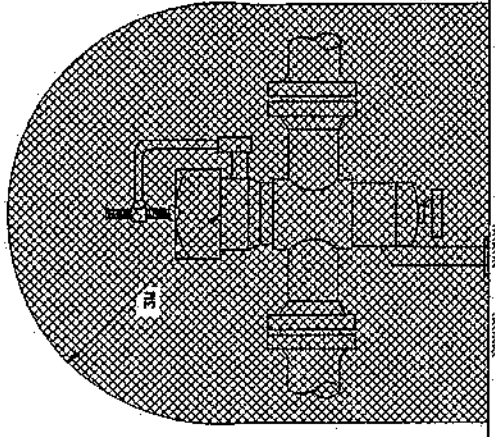


TYPICAL STRAINER/VESSEL

100 (PART. 15) SECT. 5.6.1

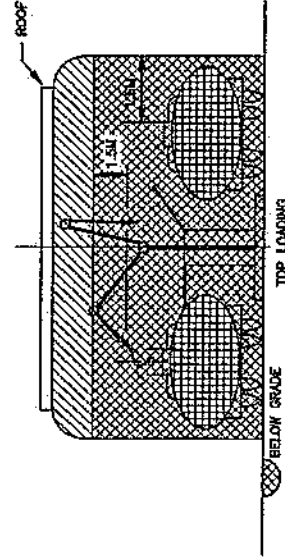ROAD LOADING

IP (PART 15) SECT. 1.3
IP (PART 15) SECT. 0.5.1.3

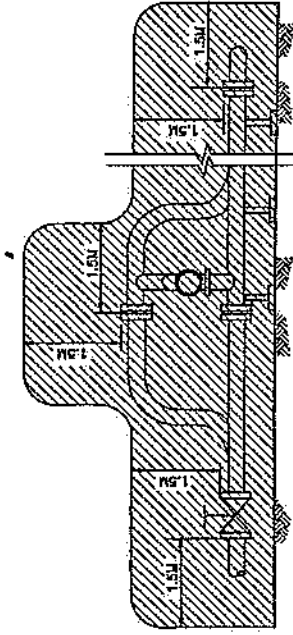

PROVER

IP (PART 15) SECT. 5.10.3
IP (PART 15) SECT. 5.10.5

[illegible]

